




# J.02 NP – GYNEKOLOGIE AMBULANCE

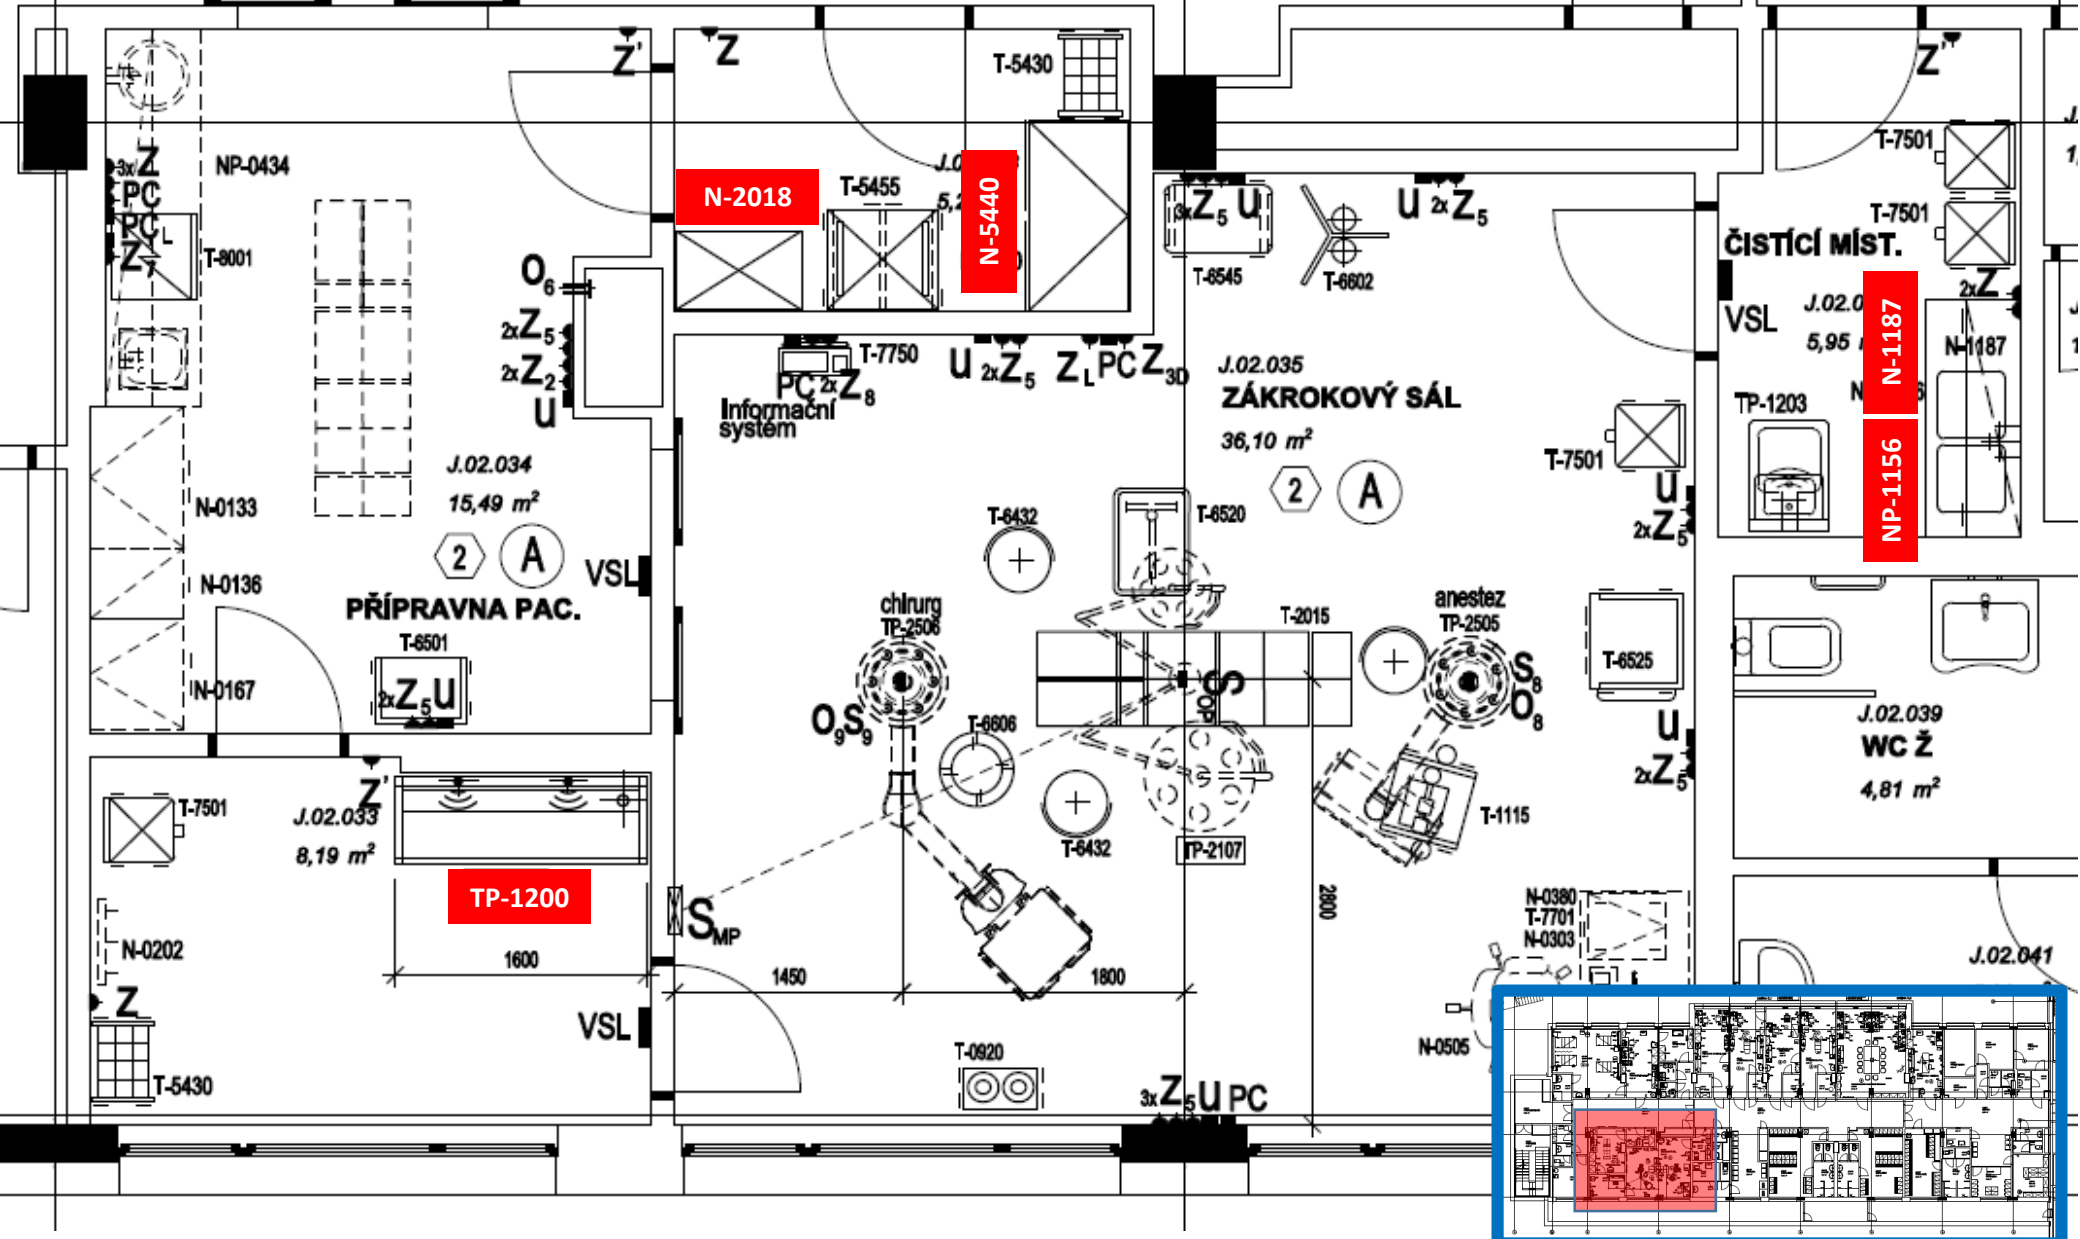

# J.03 NP – ORTOPEDIE

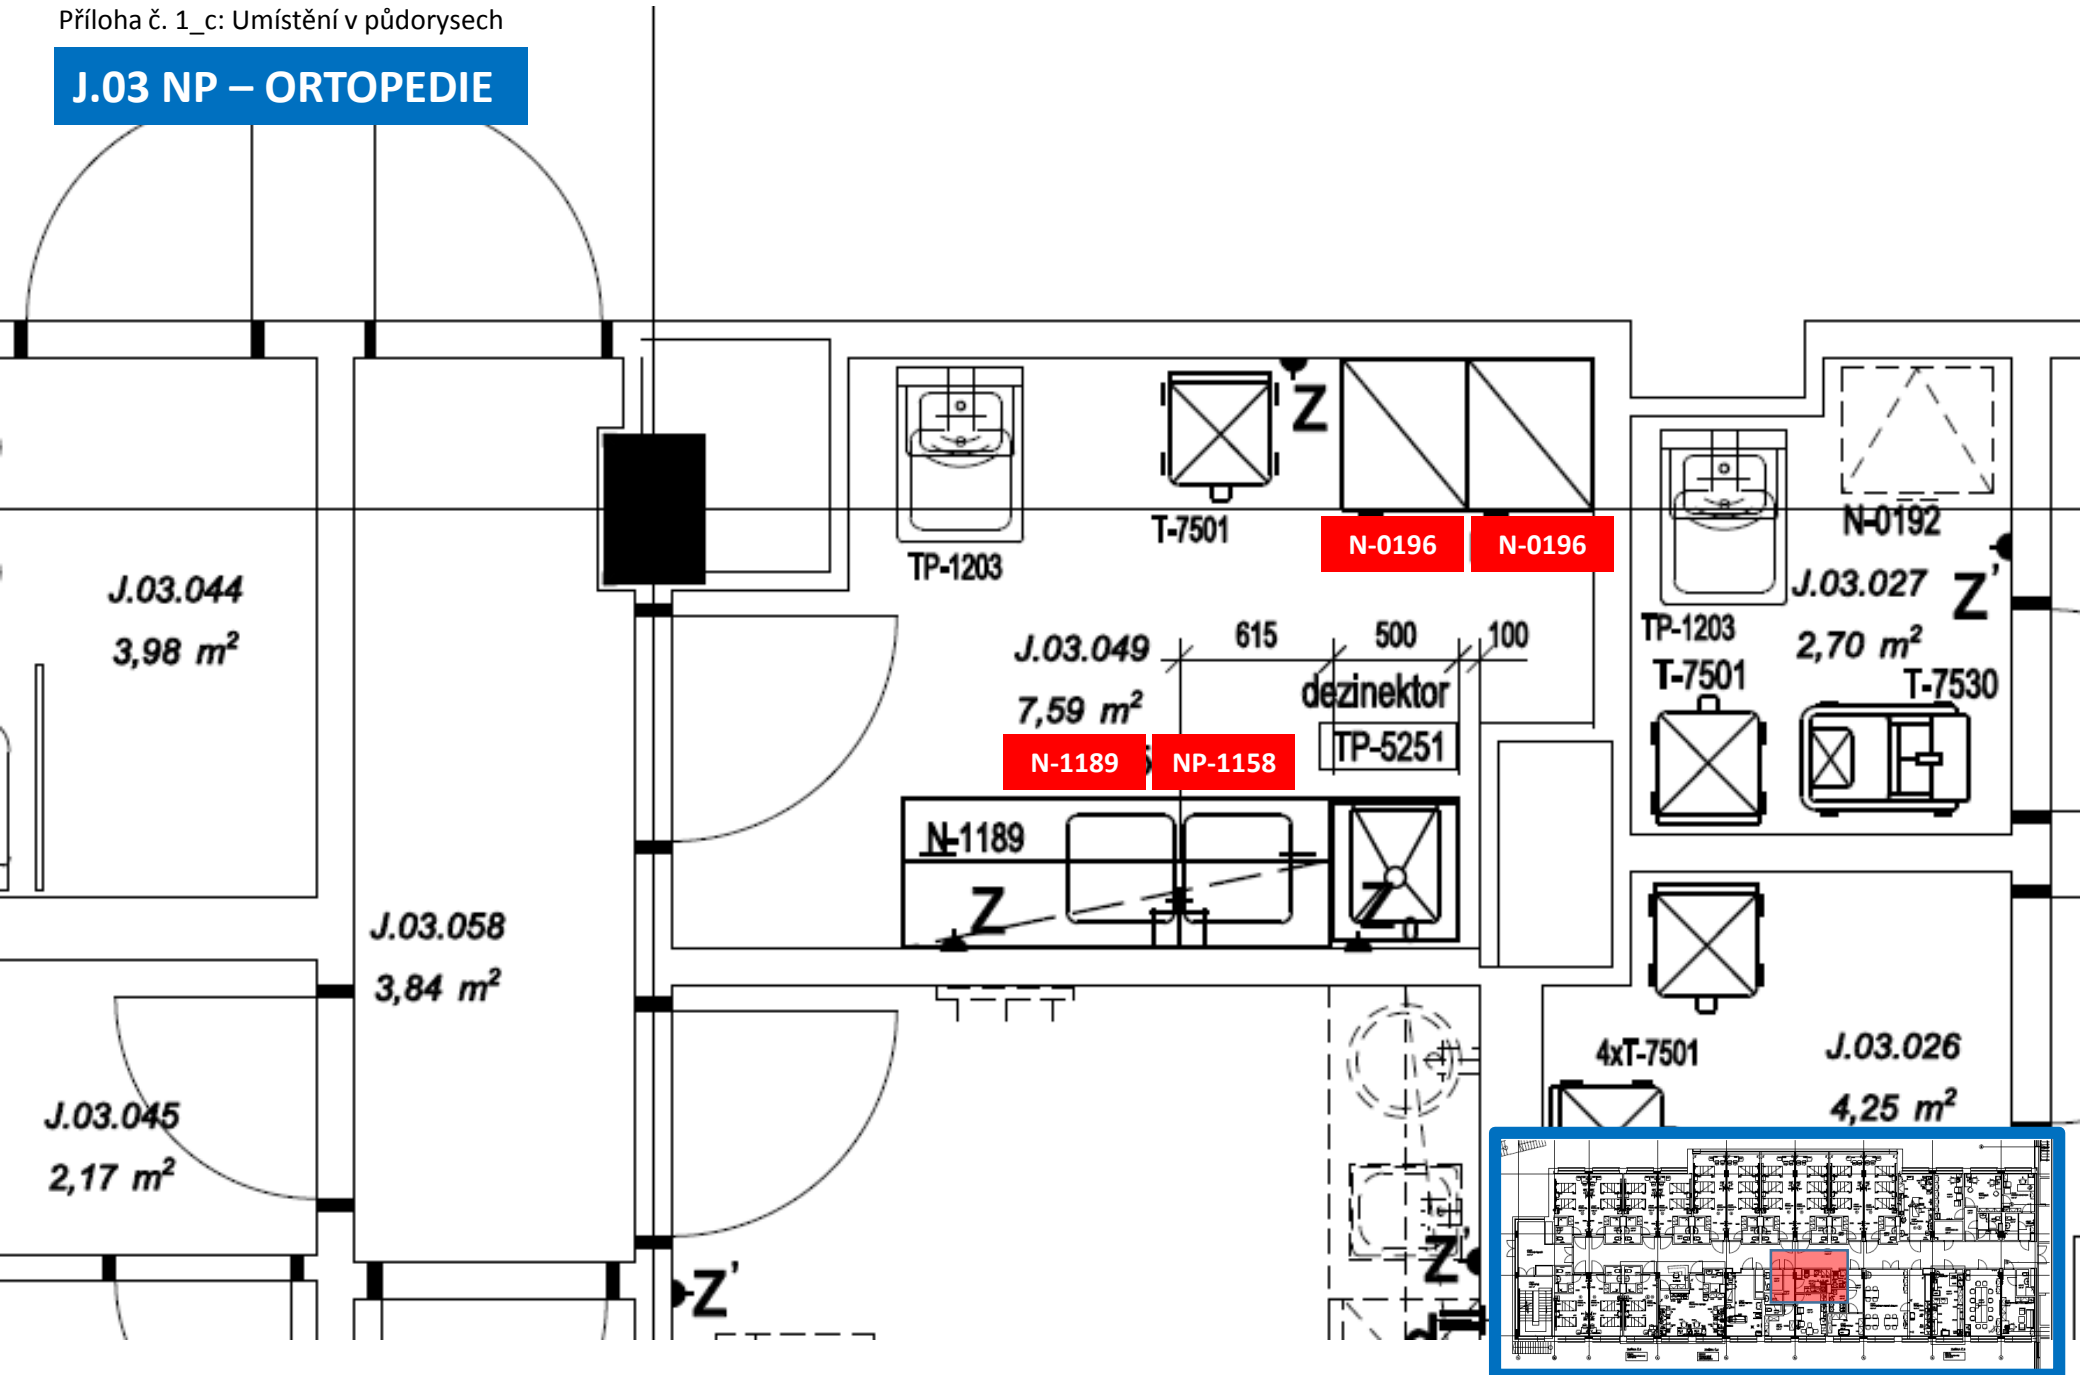

**J.04 NP – CHIRURGIE**

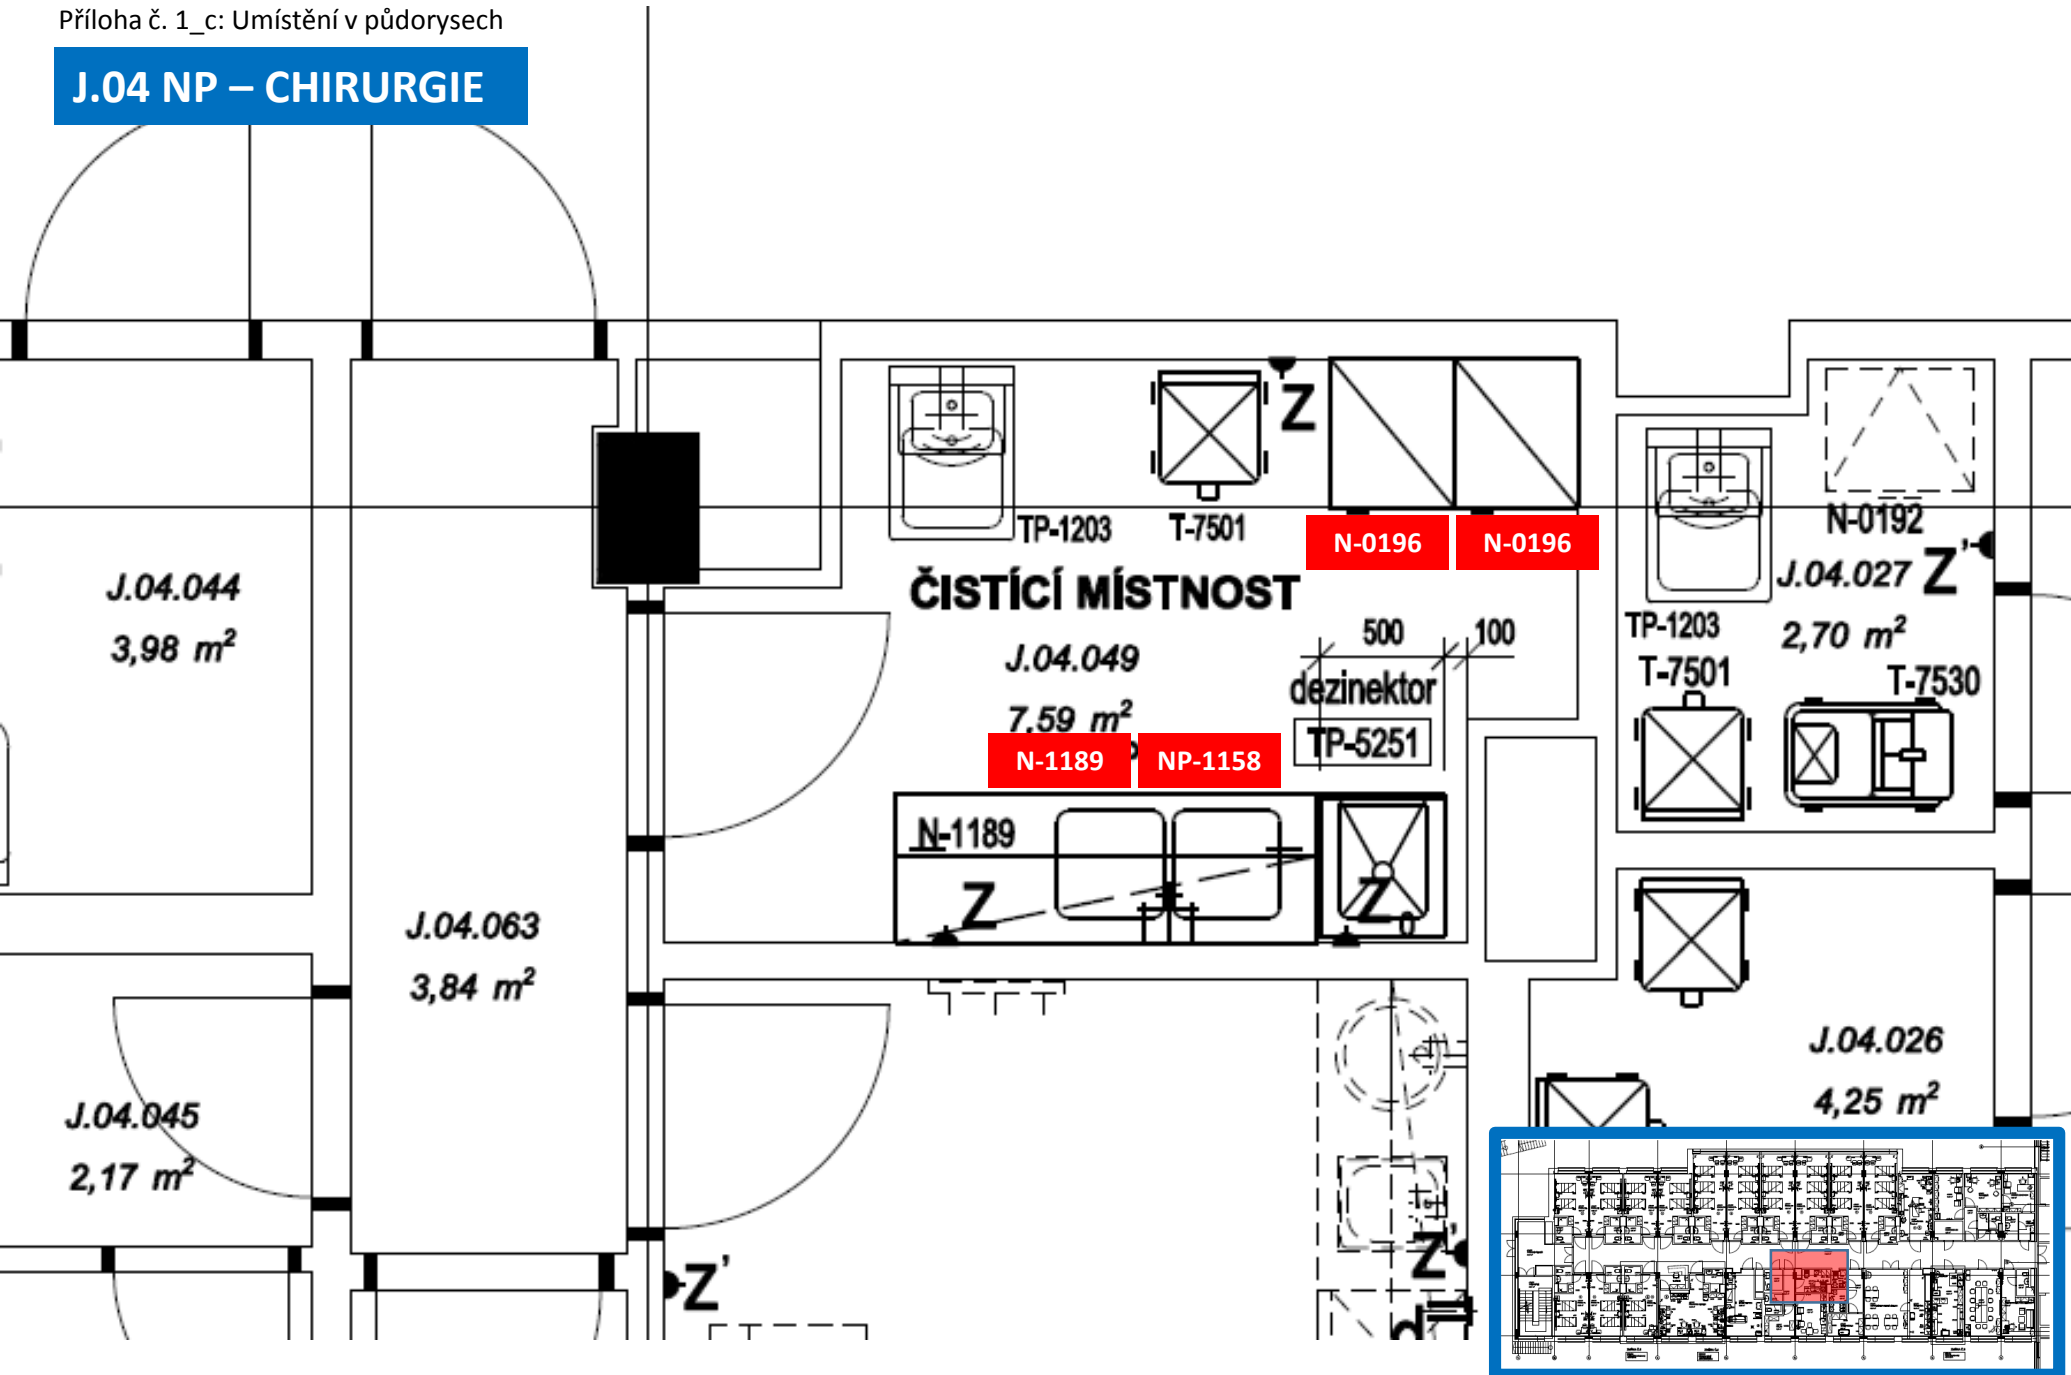

m<sup>2</sup>

**J.05 NP – CHIRURGIE**

J.05.043  
**ÚKLID**  
4,21 m<sup>2</sup>  
N-0192

J.05.046  
1,56 m<sup>2</sup>

J.05.047  
2,01 m<sup>2</sup>

**ČISTÝ MATERIÁL**  
J.05.048  
3,99 m<sup>2</sup>

J.05.045  
**ČISTÍCÍ MÍSTNOST**  
1,87 m<sup>2</sup>

J.05.049  
18,99 m<sup>2</sup>  
**ODPOČINKOVÁ MÍSTNOST**

N-0196

NP-1158


dezinfektor  
TP-5251

ZS-1203

T-7501

T-7509


N-1189

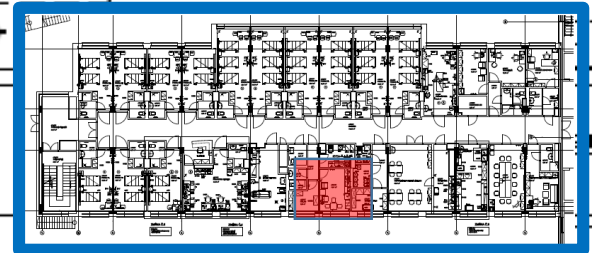




# J.07 NP – PORODNICE

T-8014  
0356601  
**KOJ 1L MATKA+DÍTĚ**  
5 m<sup>2</sup>

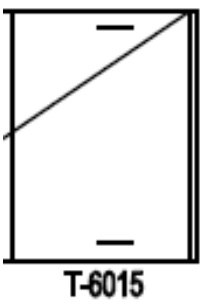

1






T-7717

2x Z  
STA




N-0361



J.07.042  
2,31 m<sup>2</sup>



ZS-1203



T-7530

Z

550

dezinfičátor  
TP-5251

J.07.041  
**ČISTÍCÍ MÍSTNOST**  
9,84 m<sup>2</sup>

625

NP-1


N-0196

NP-1158


N-1189

N-1189


TP-2504




T-6102




T-6102




J.07.046  
22,62 m<sup>2</sup>



T-6105





T-6105

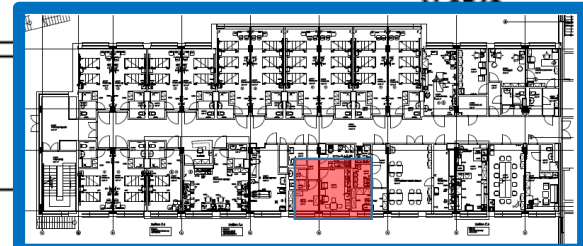






# K.02 NP – STERILIZACE

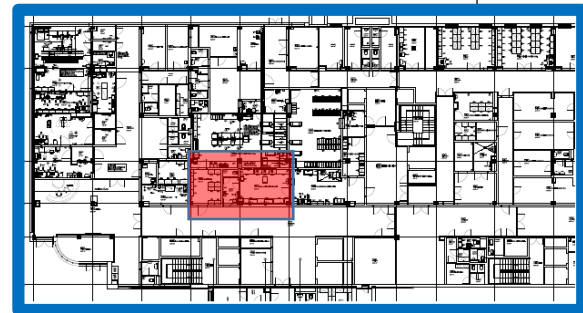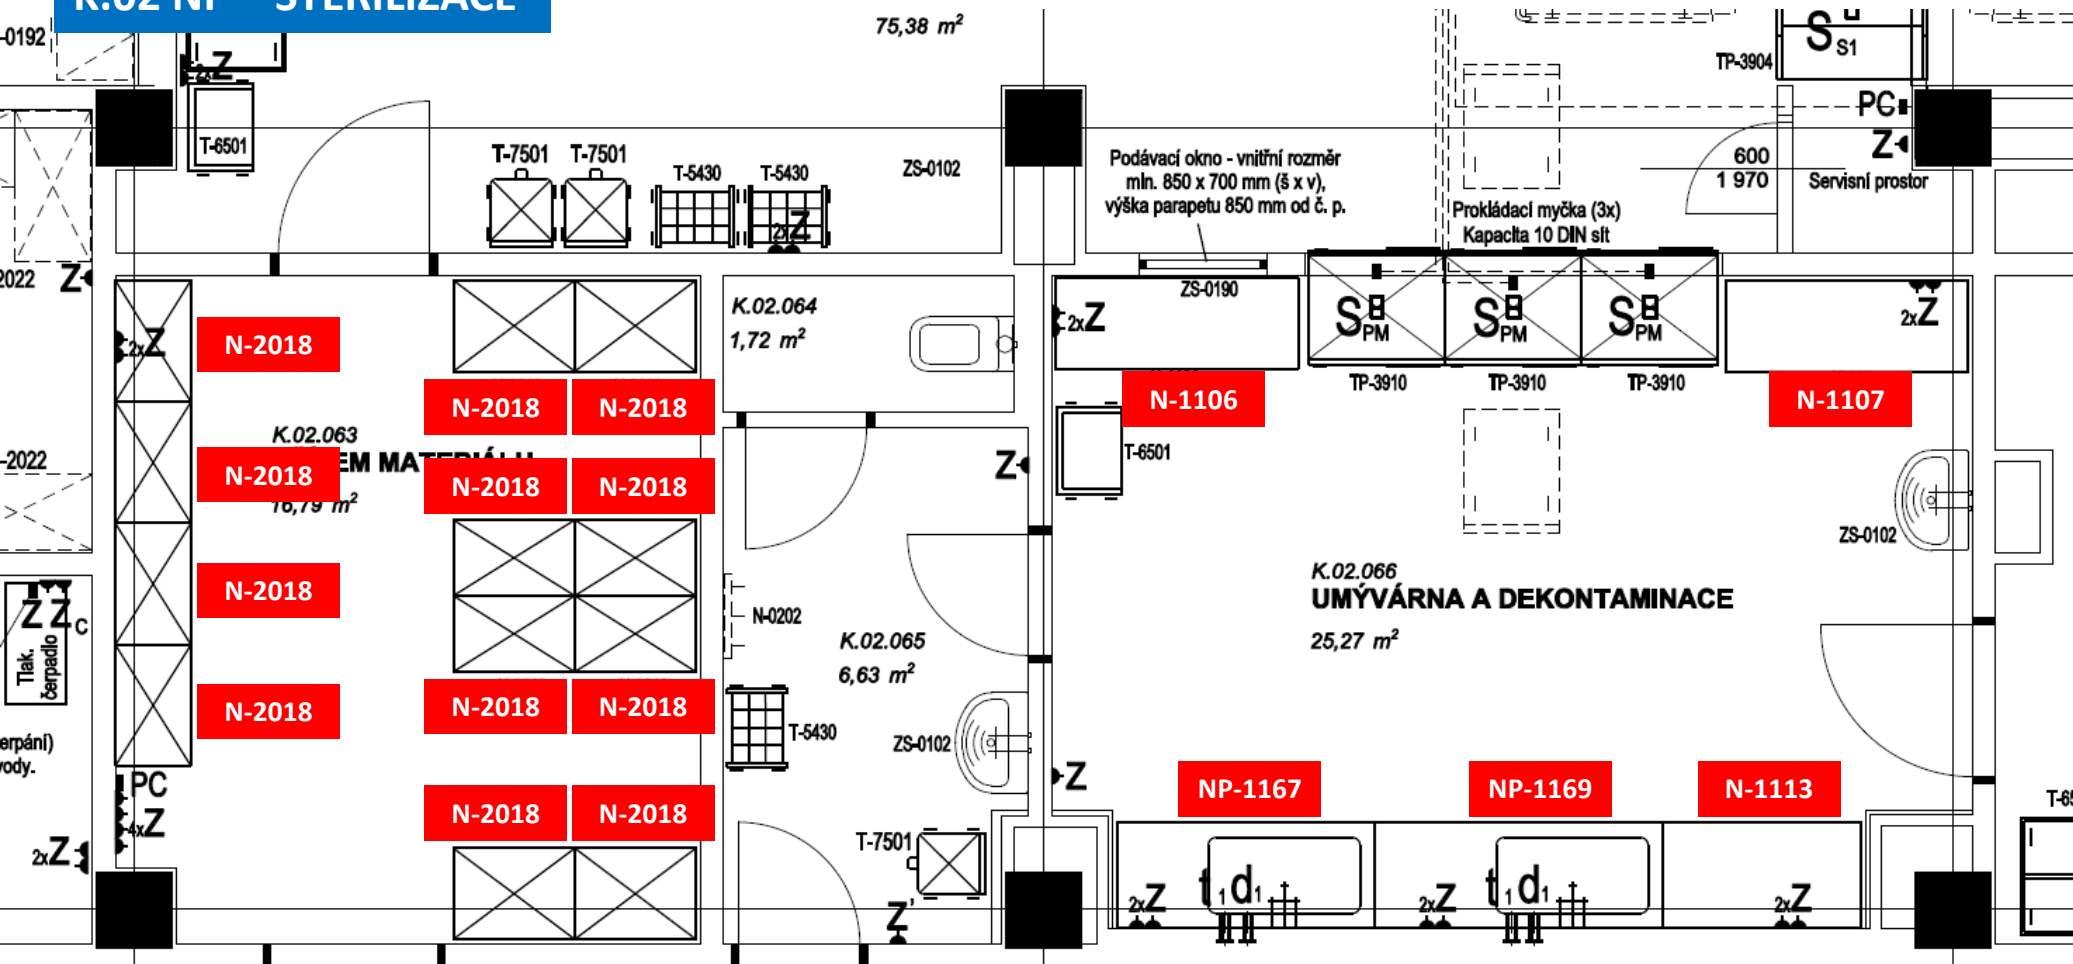



# K.02 NP – STERILIZACE

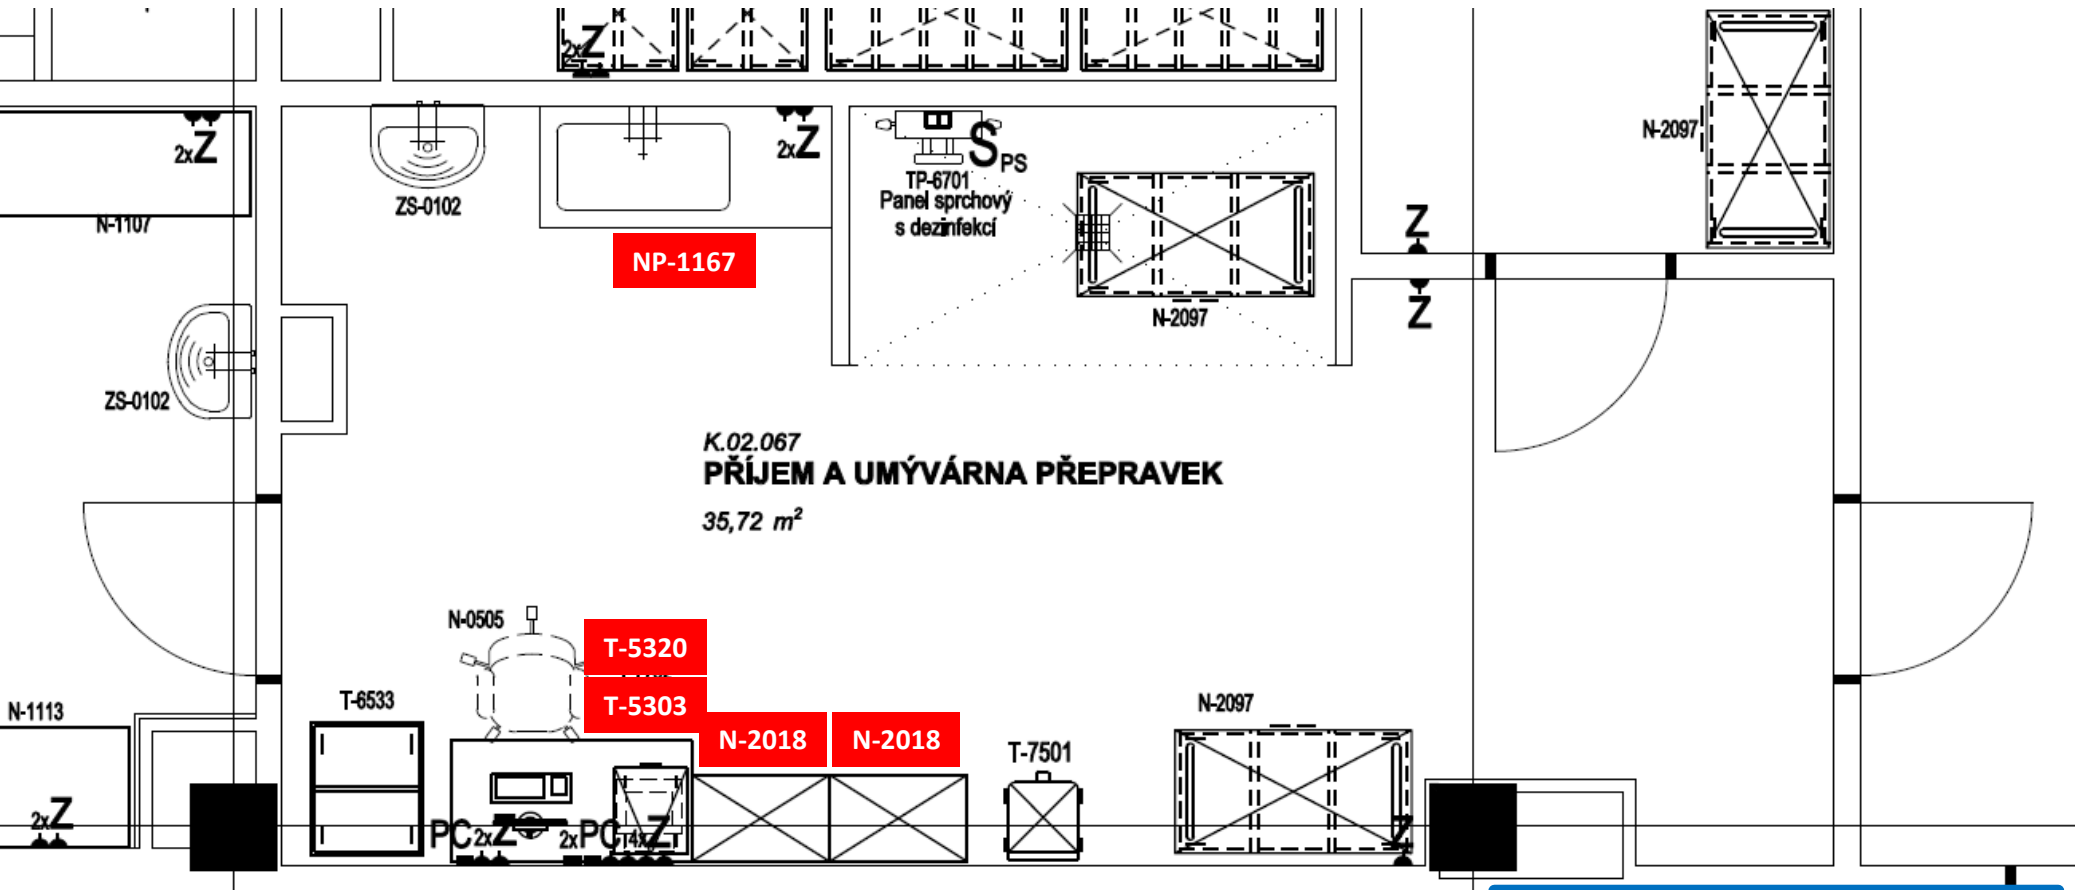

# K.02 NP – STERILIZACE

K.02.053  
**FILTR STERILNÍ**  
1-7501C  
8,48 m<sup>2</sup>

ZS-0102

N-2095

Parní sterilizátor  
8 STJ

TP-3908

Servisní prostor  
600  
1 970

Parní sterilizátor  
8 STJ

TP-3908

Parní sterilizátor  
4 STJ

TP-3904

600  
1 970  
Servisní prostor

Prokládací myčka (3x)  
Kapacita 10 DIN slit

3xZ PC

2xZ

N-2030

N-2030

N-2030

N-2030

N-2030

N-2030

N-2030

N-2030

K.02.072  
**SKLAD STERILNÍHO MATERIÁLU**  
60,93 m<sup>2</sup>

N-2095

N-2095

N-2095

N-2095

N-2094

N-2094

N-2095

N-2095

K.02.073  
**VÝDEJ STERILNÍHO MAT.**  
8,68 m<sup>2</sup>


N-0380  
I-7751

N-0302

N-0505



N-0199

N-2097


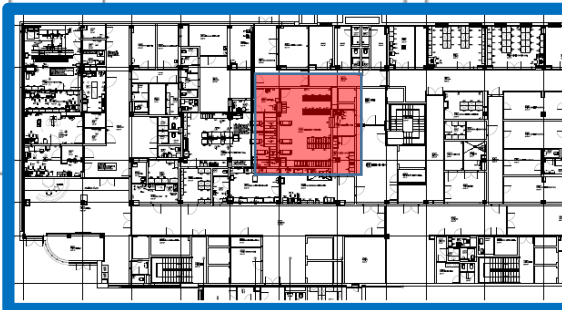


# K.03 NP – OPERAČNÍ SÁLY

NA LÉKAŘŮ + PROTOKOLY

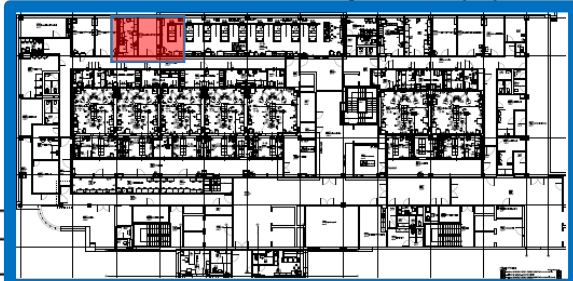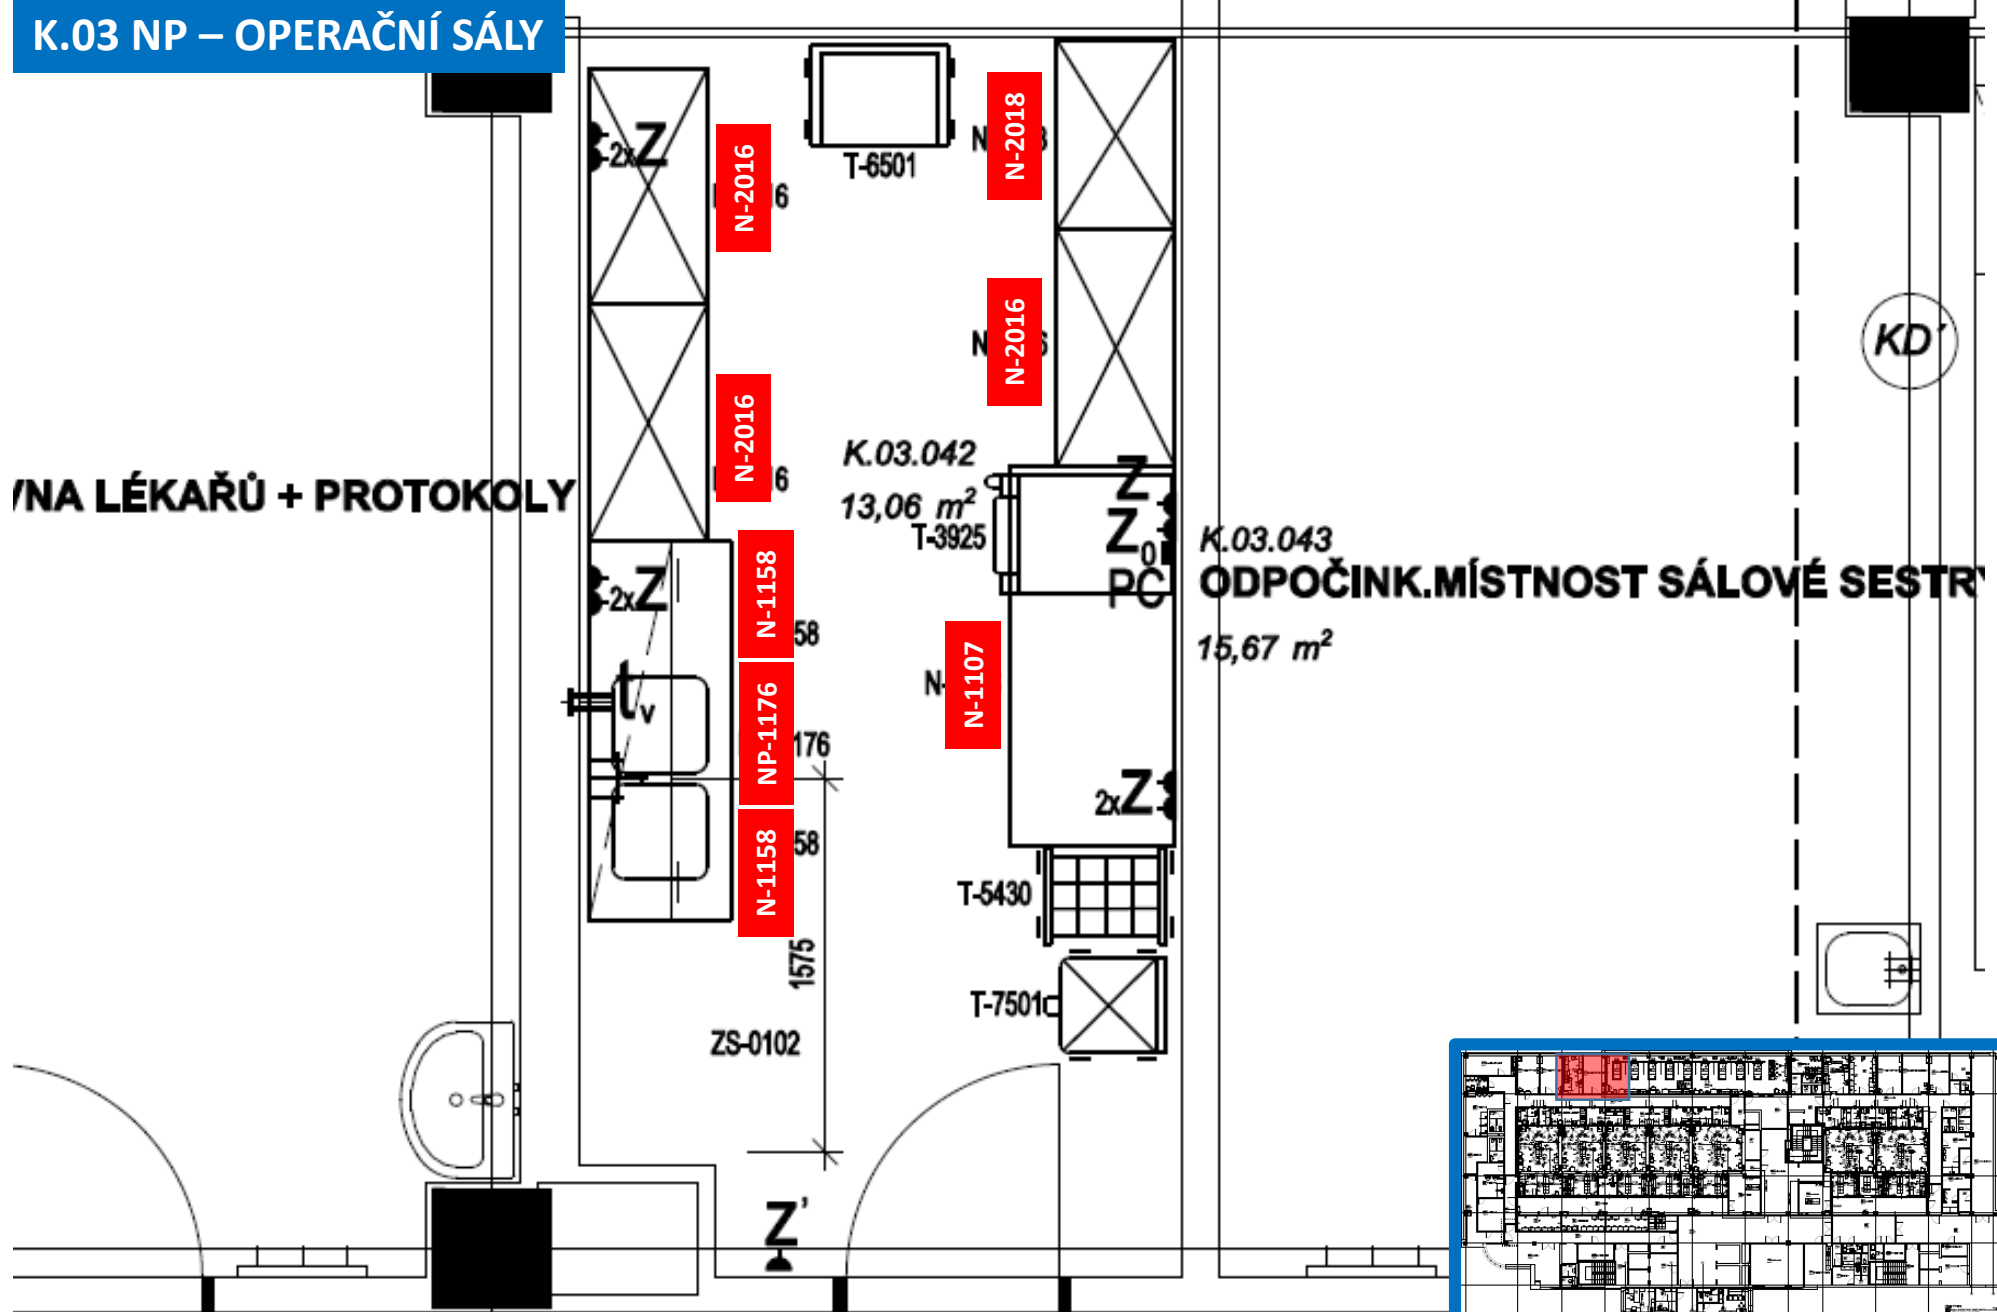


# K.03 NP – OPERAČNÍ SÁLY

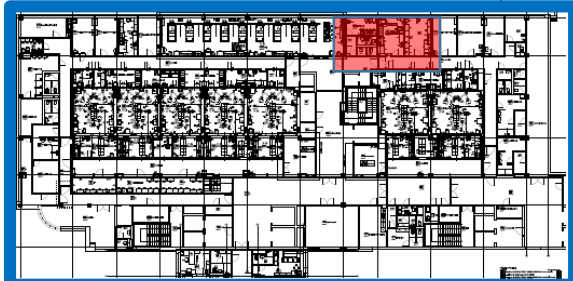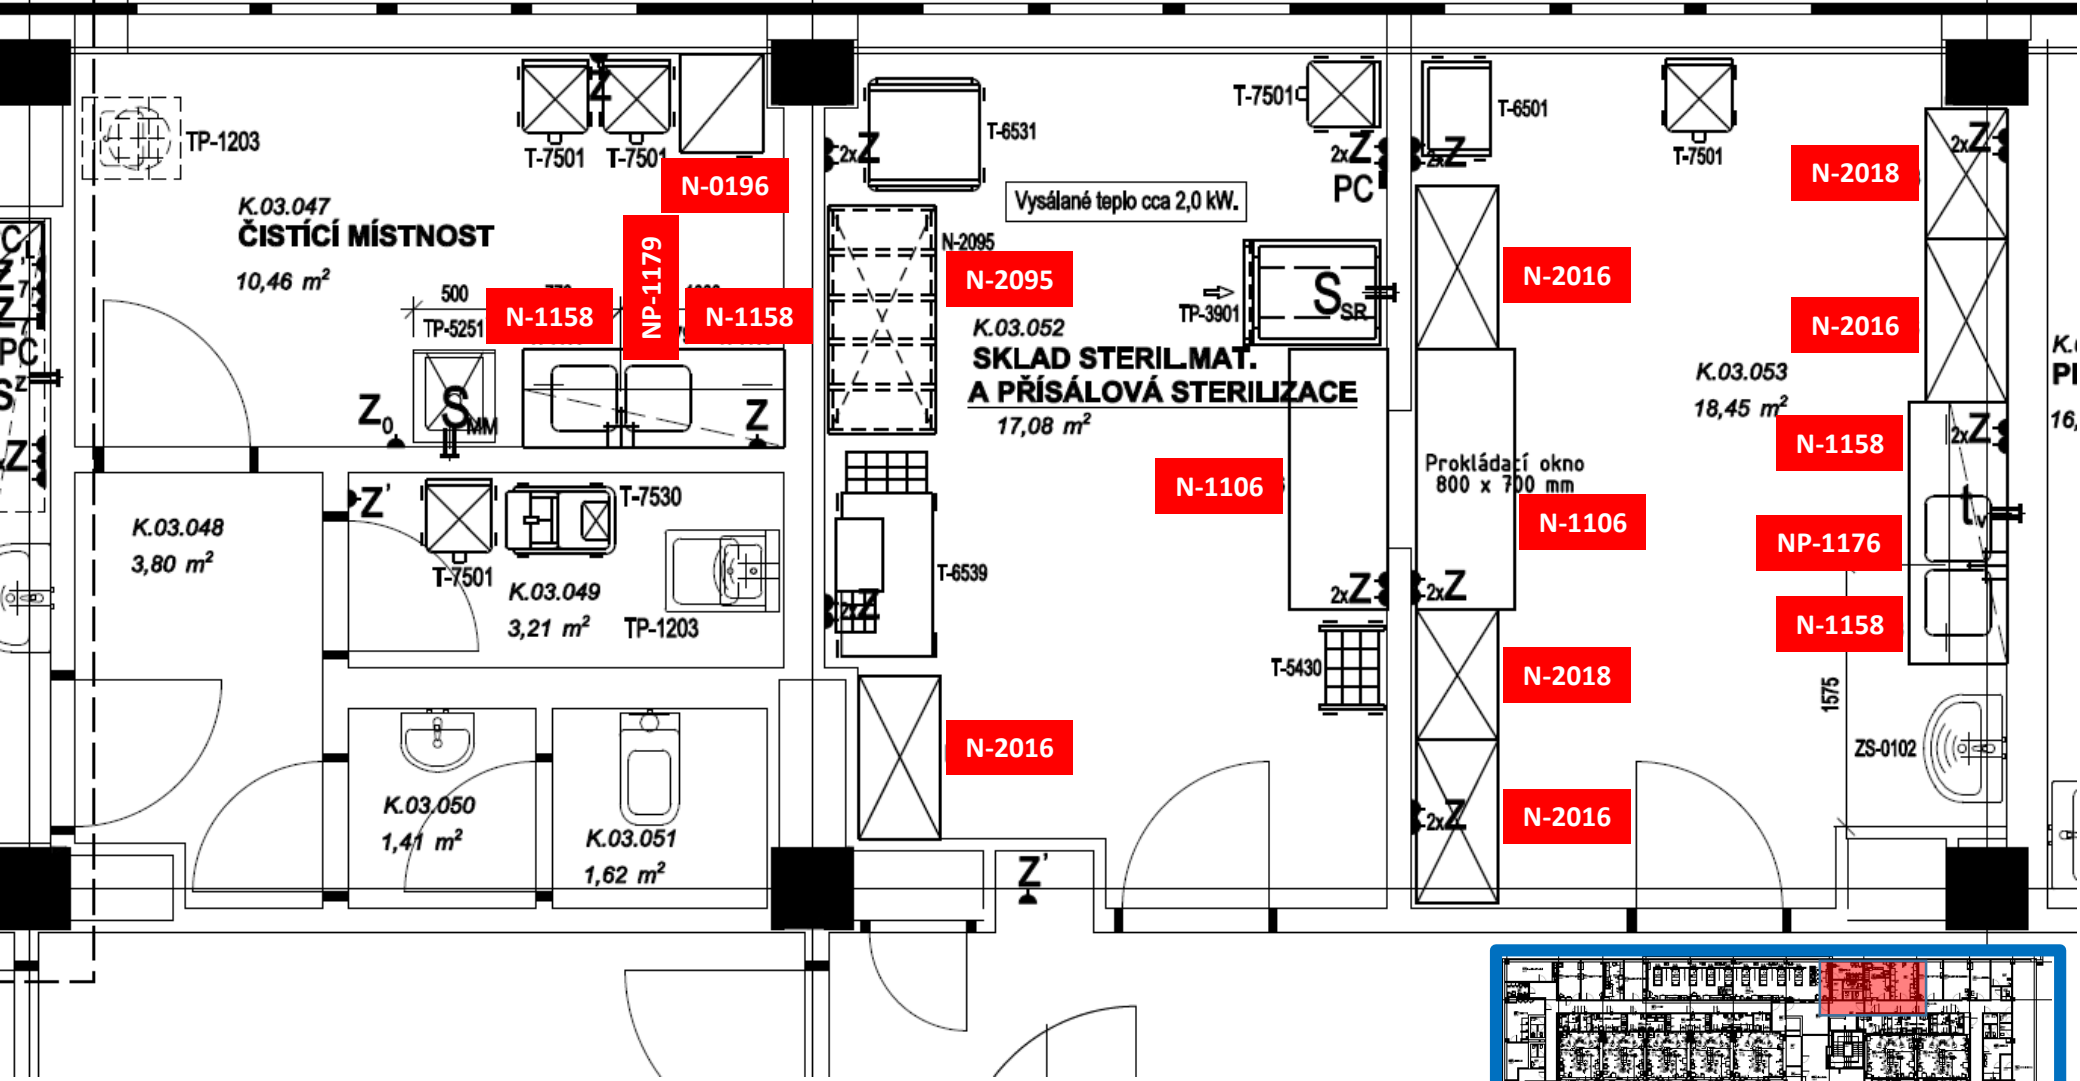


# K.03 NP – OPERAČNÍ SÁLY

## CHODBA OP SÁLY


50,36 m<sup>2</sup>

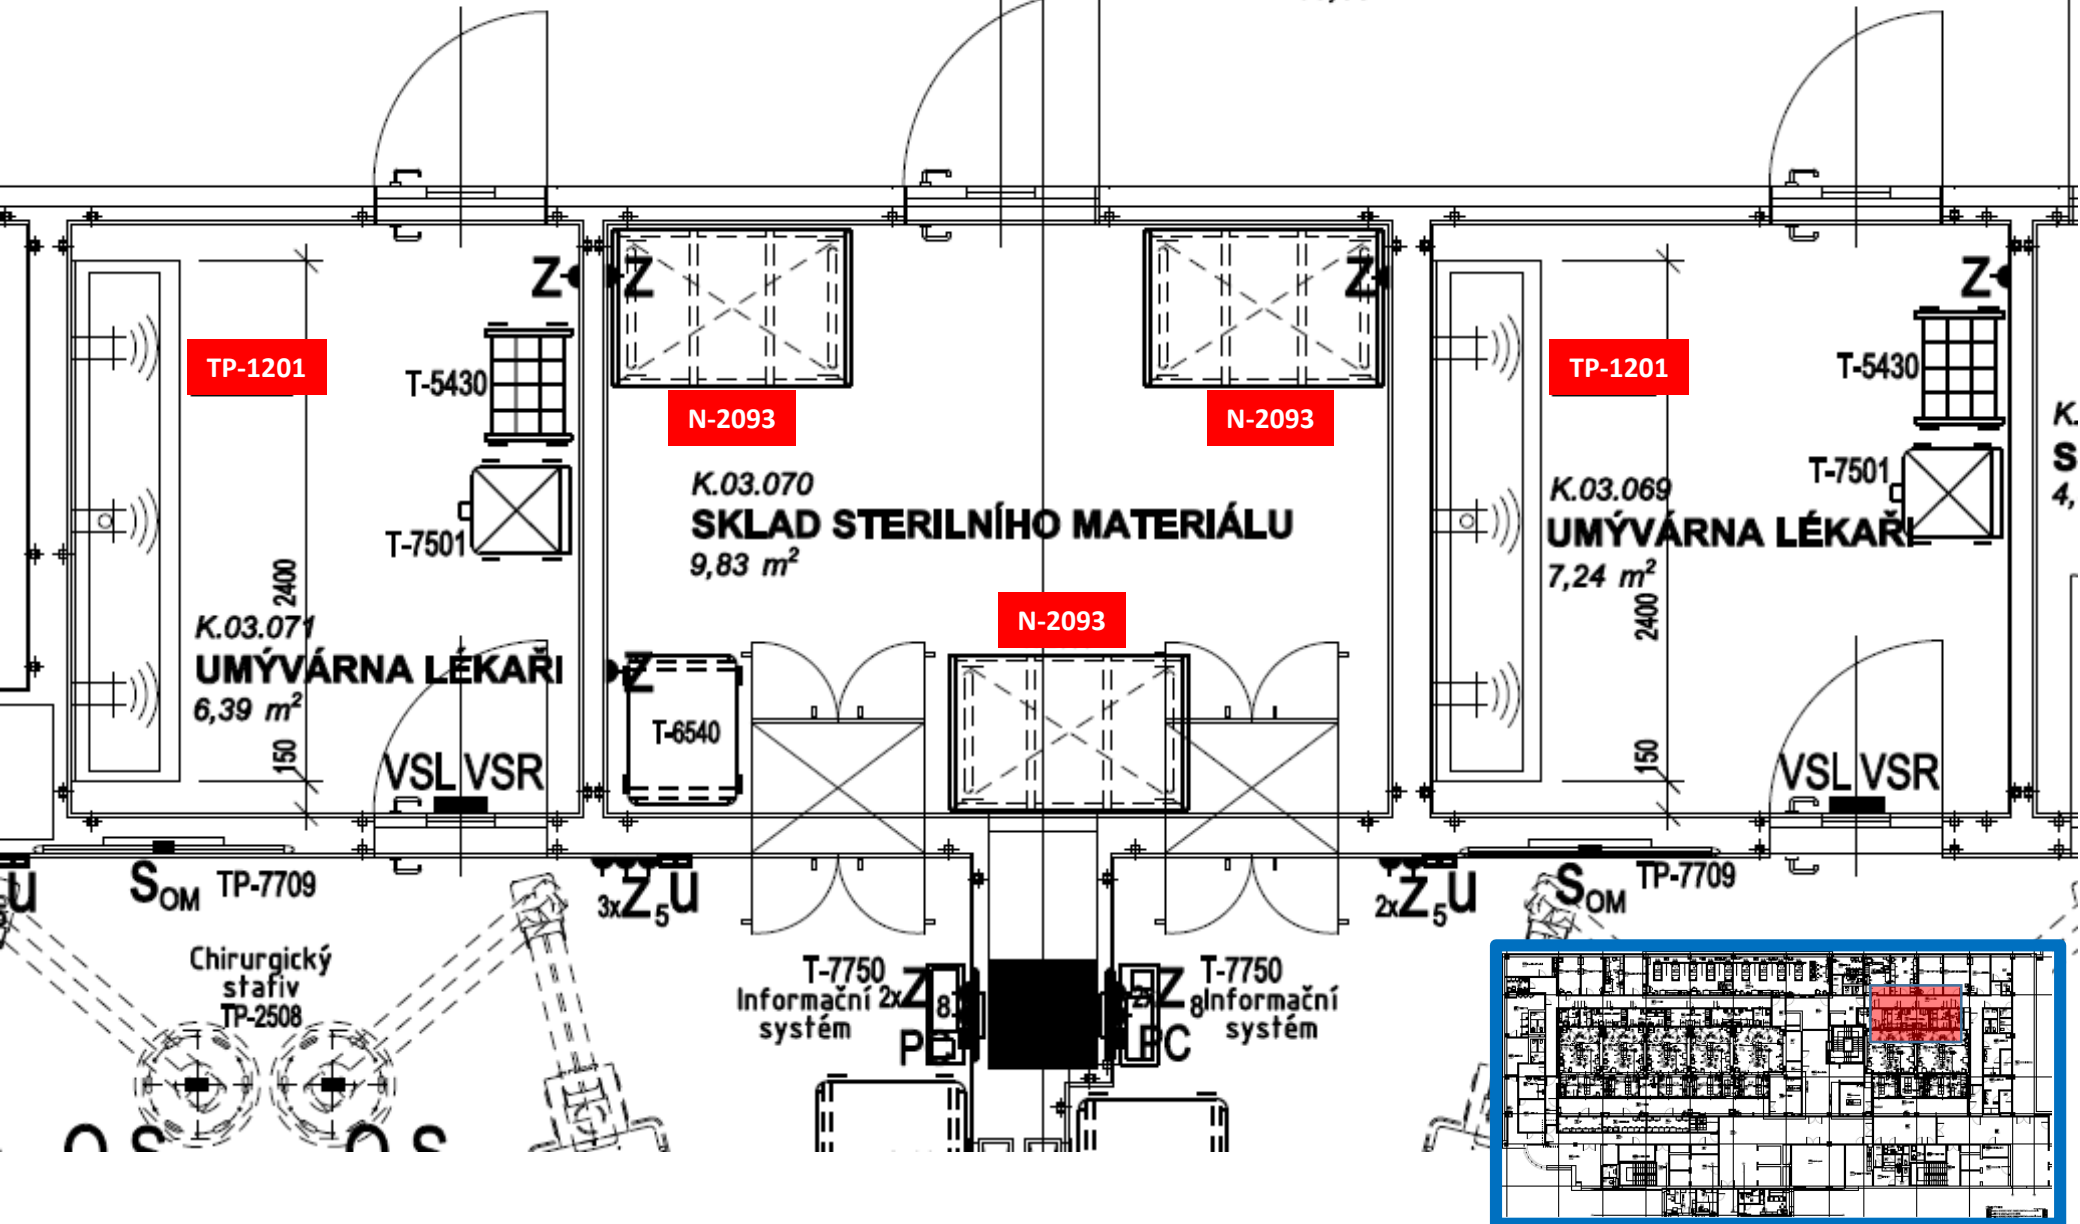

## K.03 NP – OPERAČNÍ SÁLY


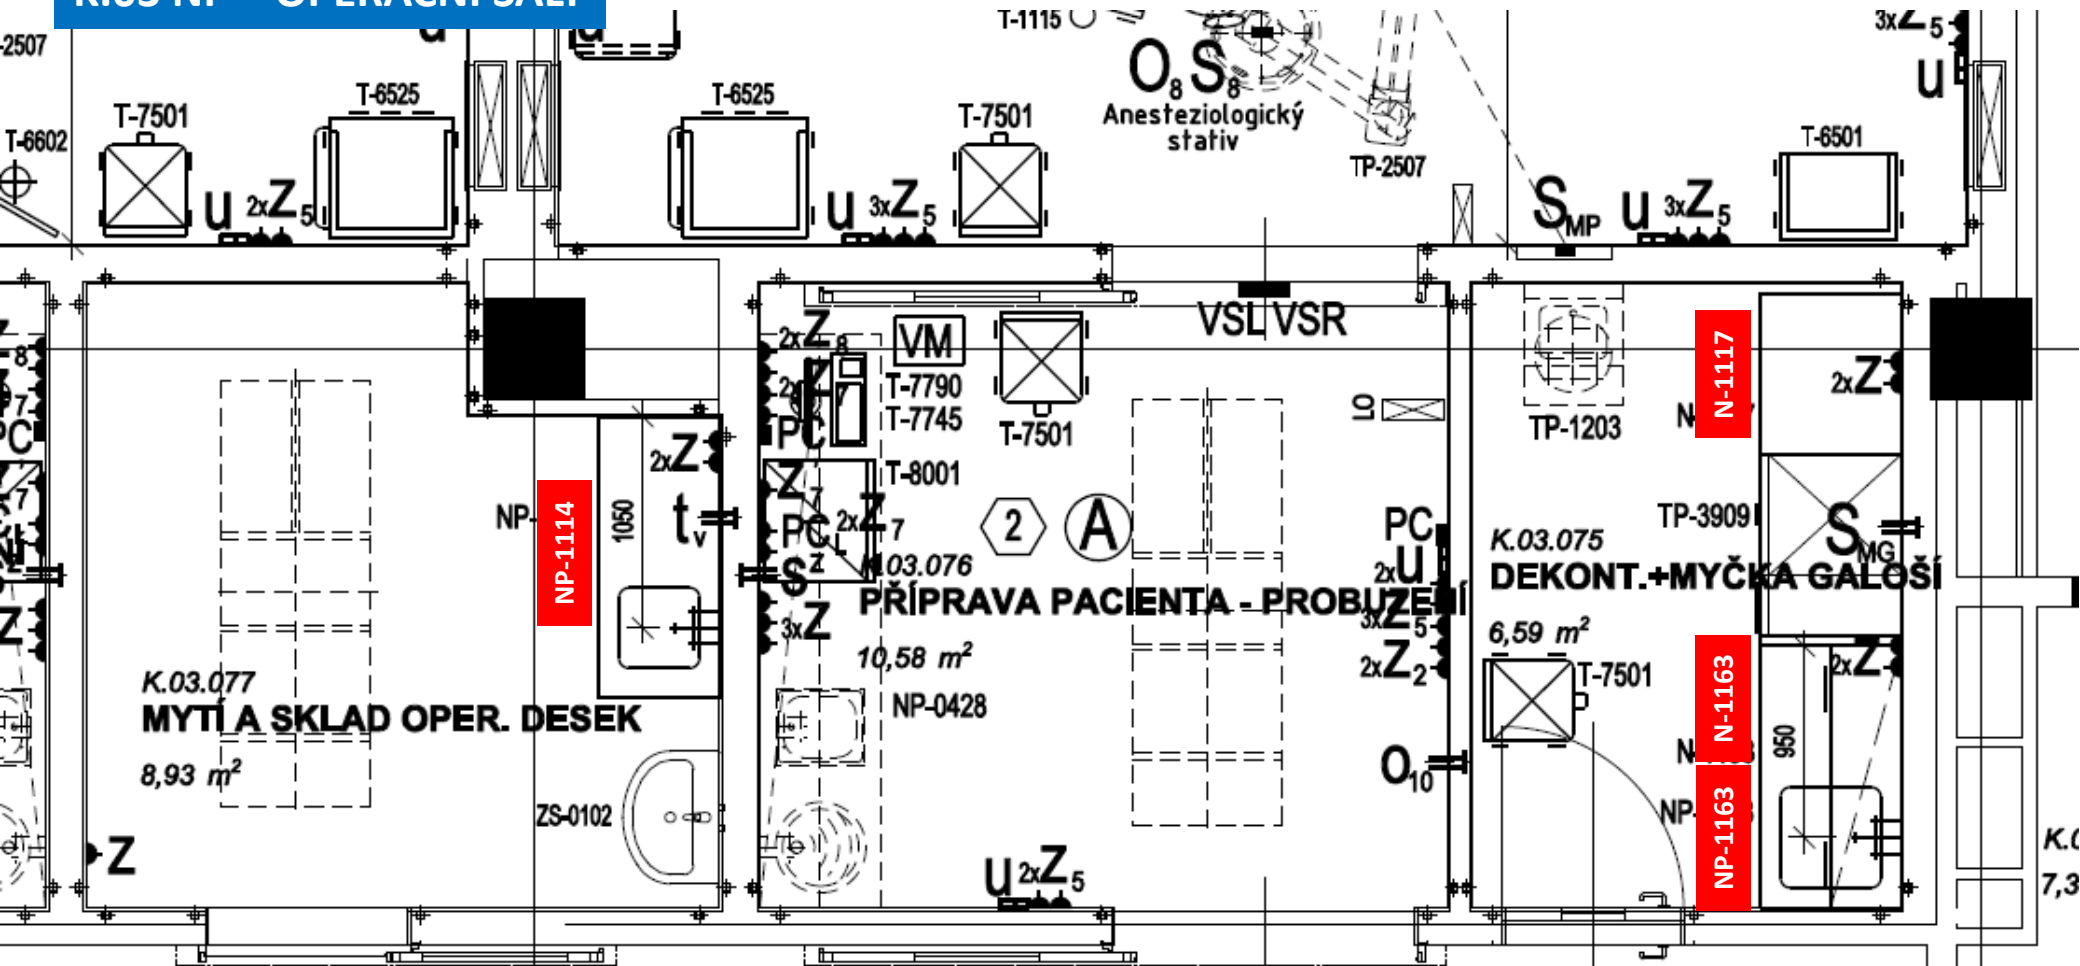


K.03.106  
**CHODBA PACIENTI**  
30,09 m<sup>2</sup>

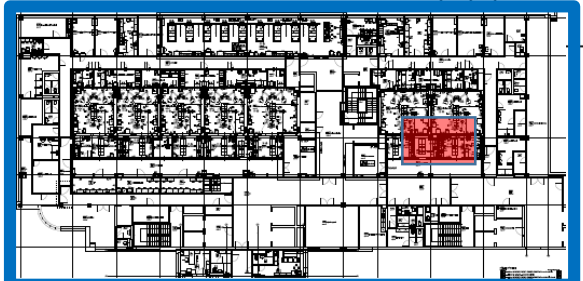





# K.03 NP – OPERAČNÍ SÁLY

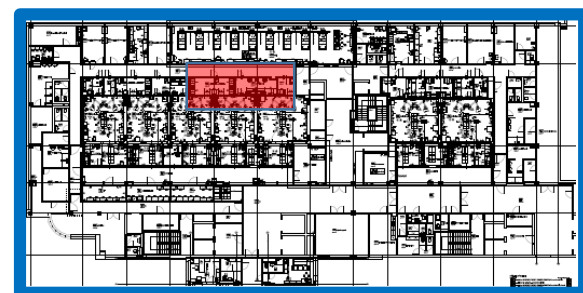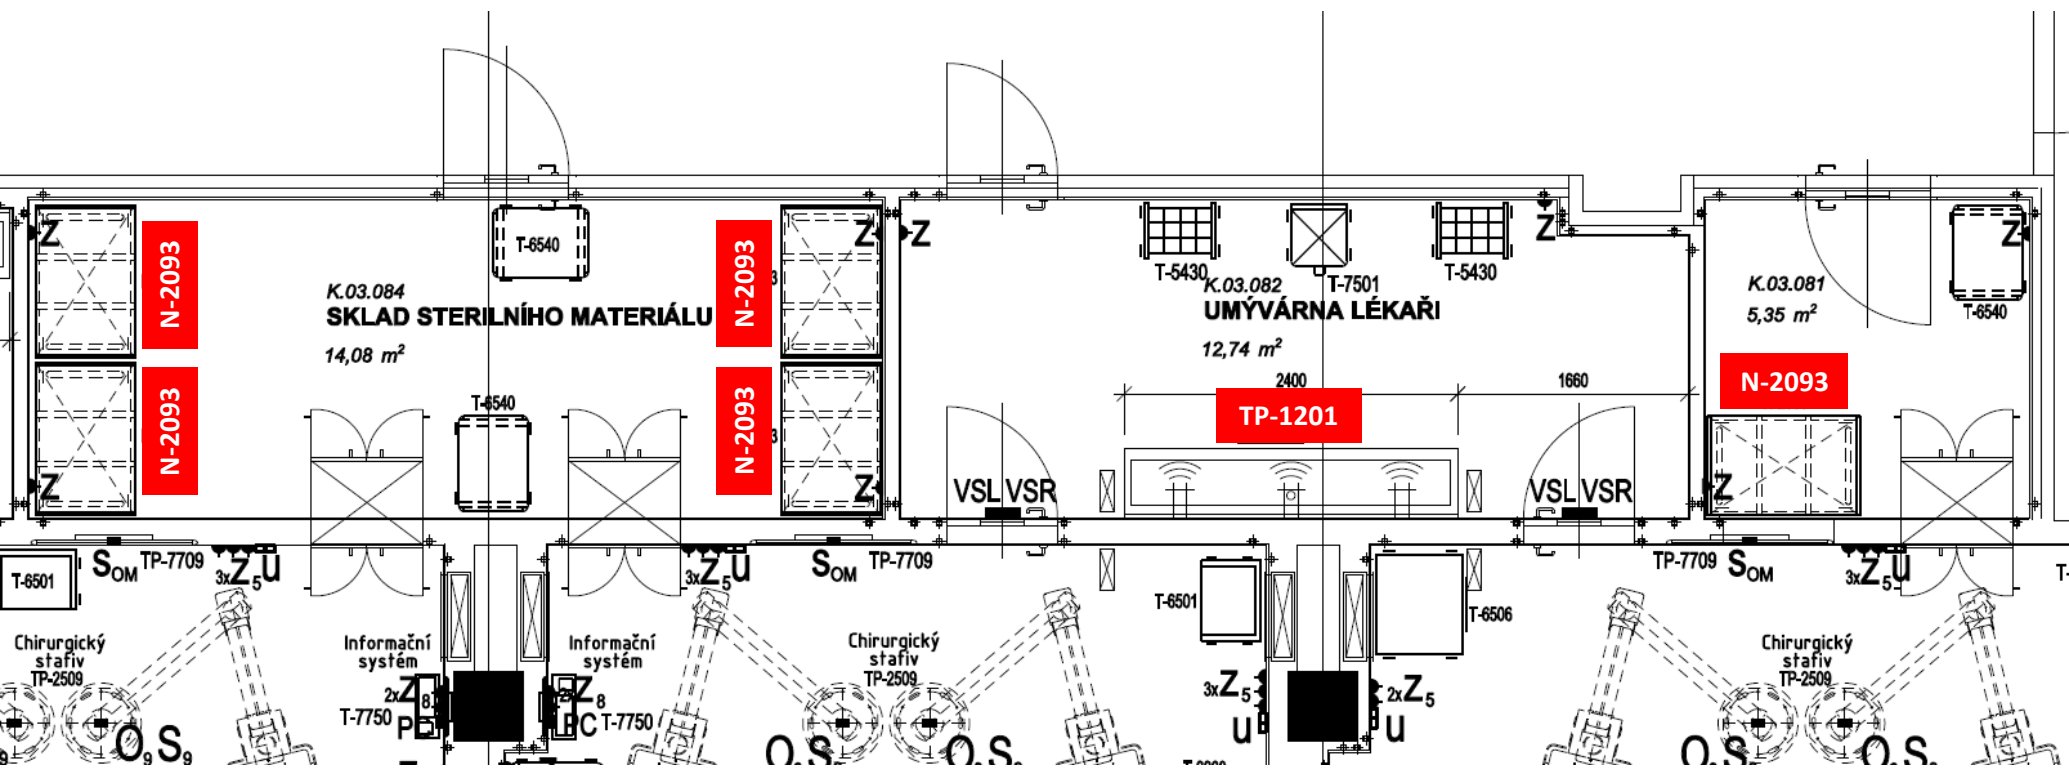





# K.03 NP – OPERAČNÍ SÁLY

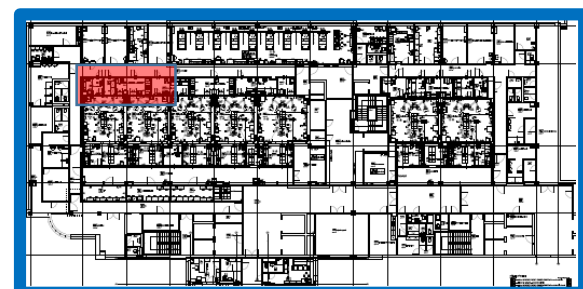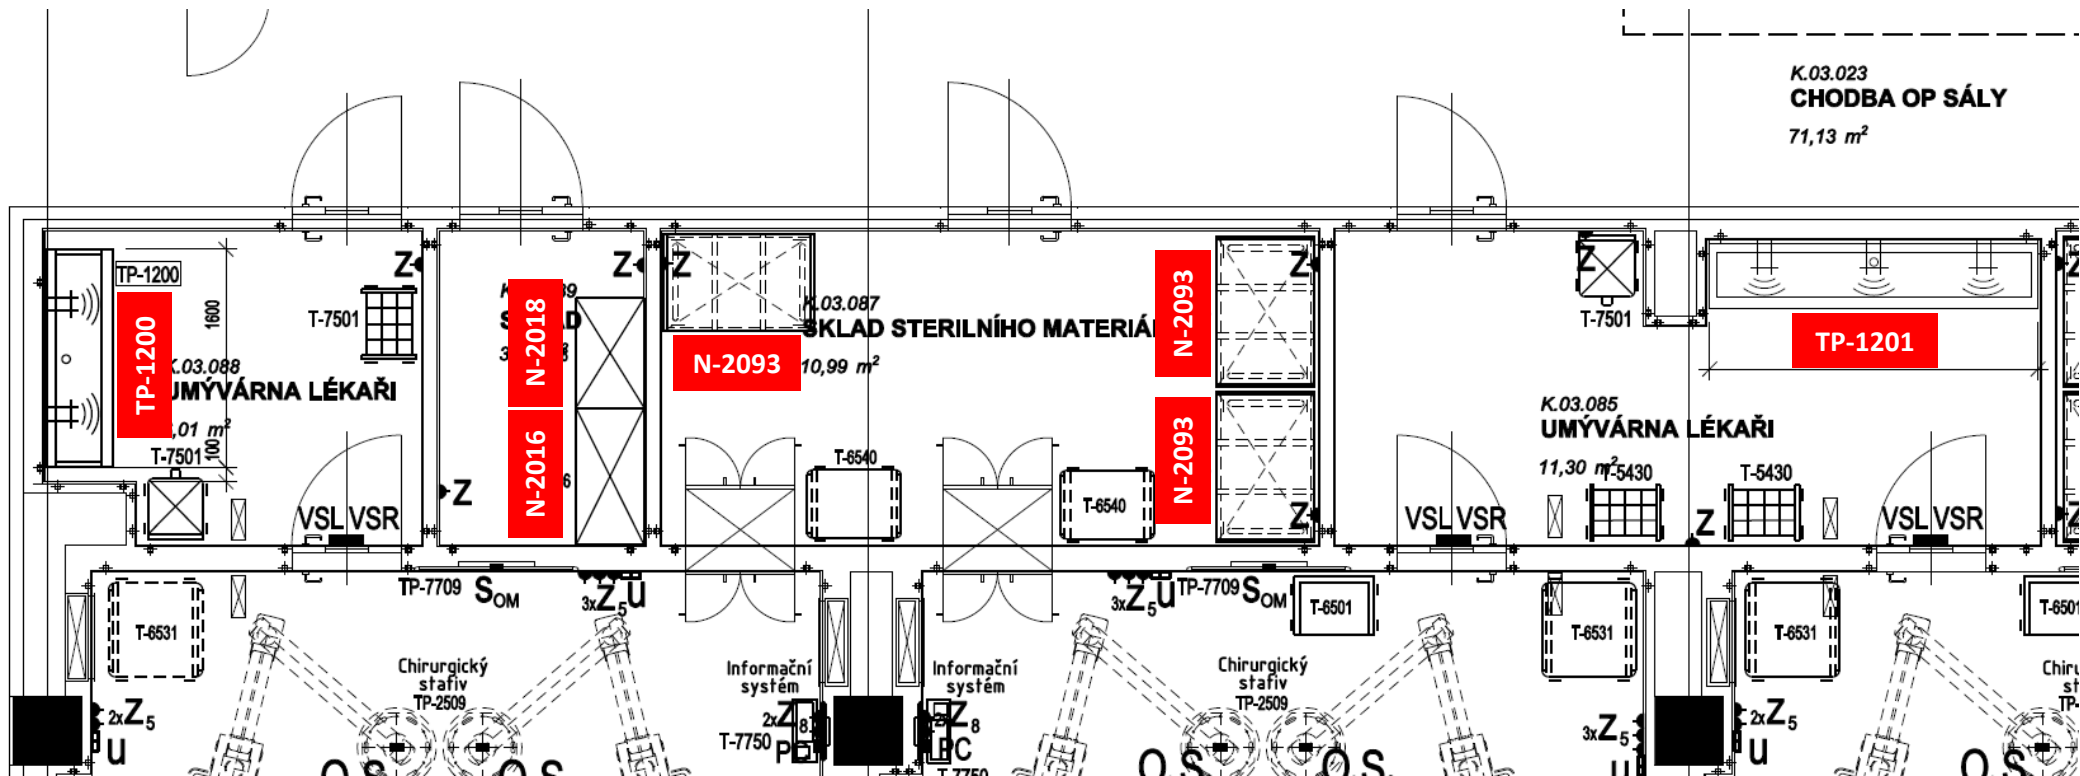



# K.03 NP – OPERAČNÍ SÁLY

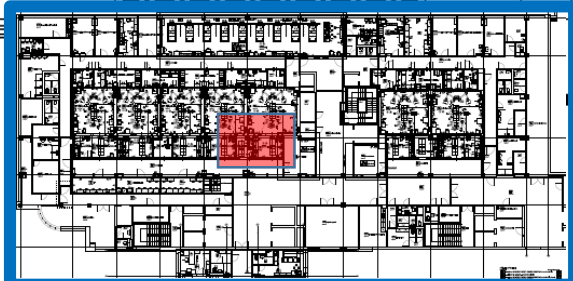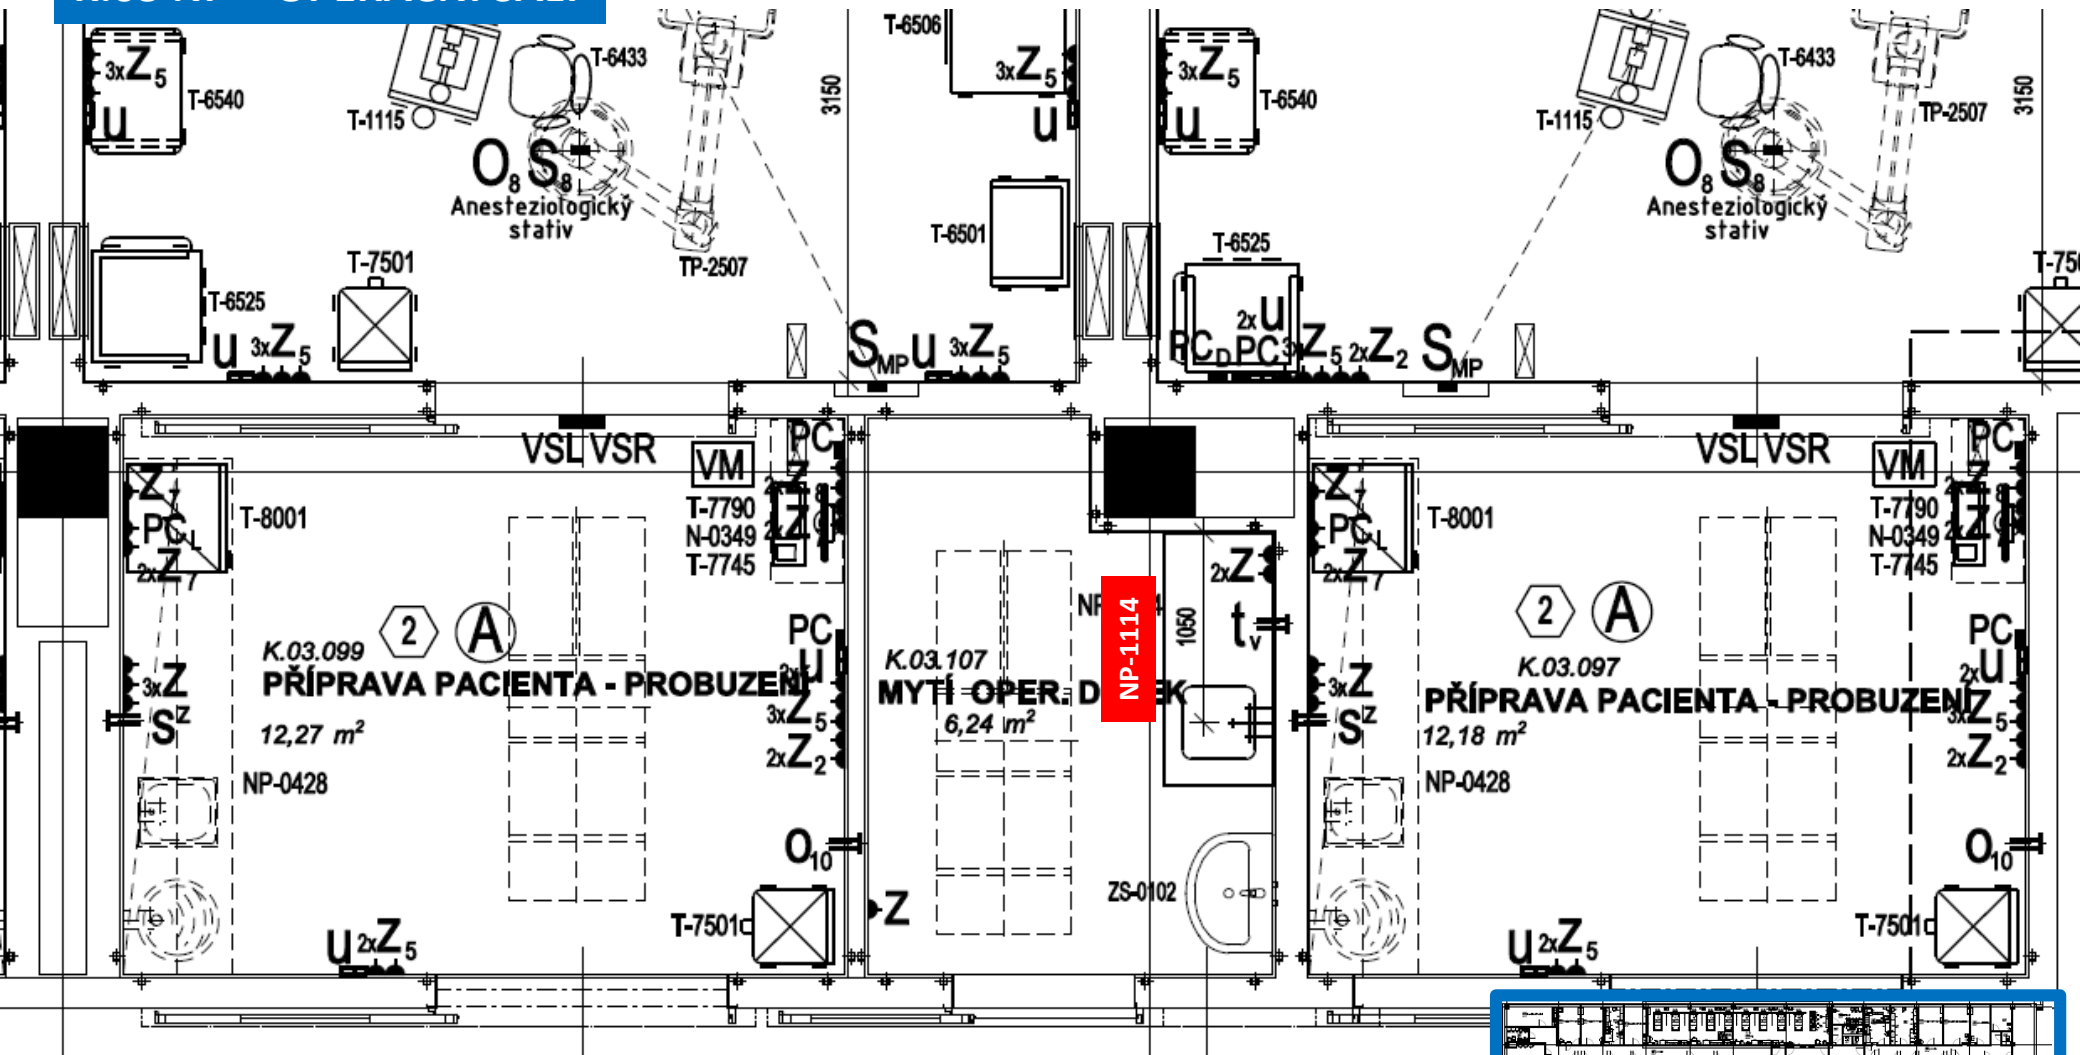

**K.05 NP – ARO**

**K.05.038  
PRACOVNA LÉKAŘE**  
15,40 m<sup>2</sup>

K.05.039

**STÍCI NOST**

m<sup>2</sup>

87

156

650

500

900

dezinfektor

TP-5251

ZS-1204

Z

T-7530

K.05.041

ZS-1203 1,68 m<sup>2</sup>


Z

N-0196  
N-0196  
N-0196




T-7501

**K.05.040  
HYG.ZÁZ.**  
6,56 m<sup>2</sup>



N-0501

T-620



Z<sup>05</sup>

2x Z<sub>5</sub>

U


T-7501

Z<sub>4x</sub>


NP-0

K.05.042  
3,08 m<sup>2</sup>


2x N-2023

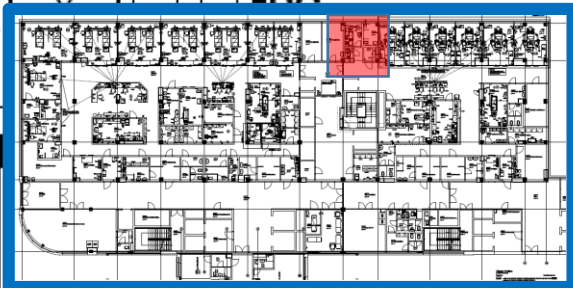



**K.05 NP – ARO**

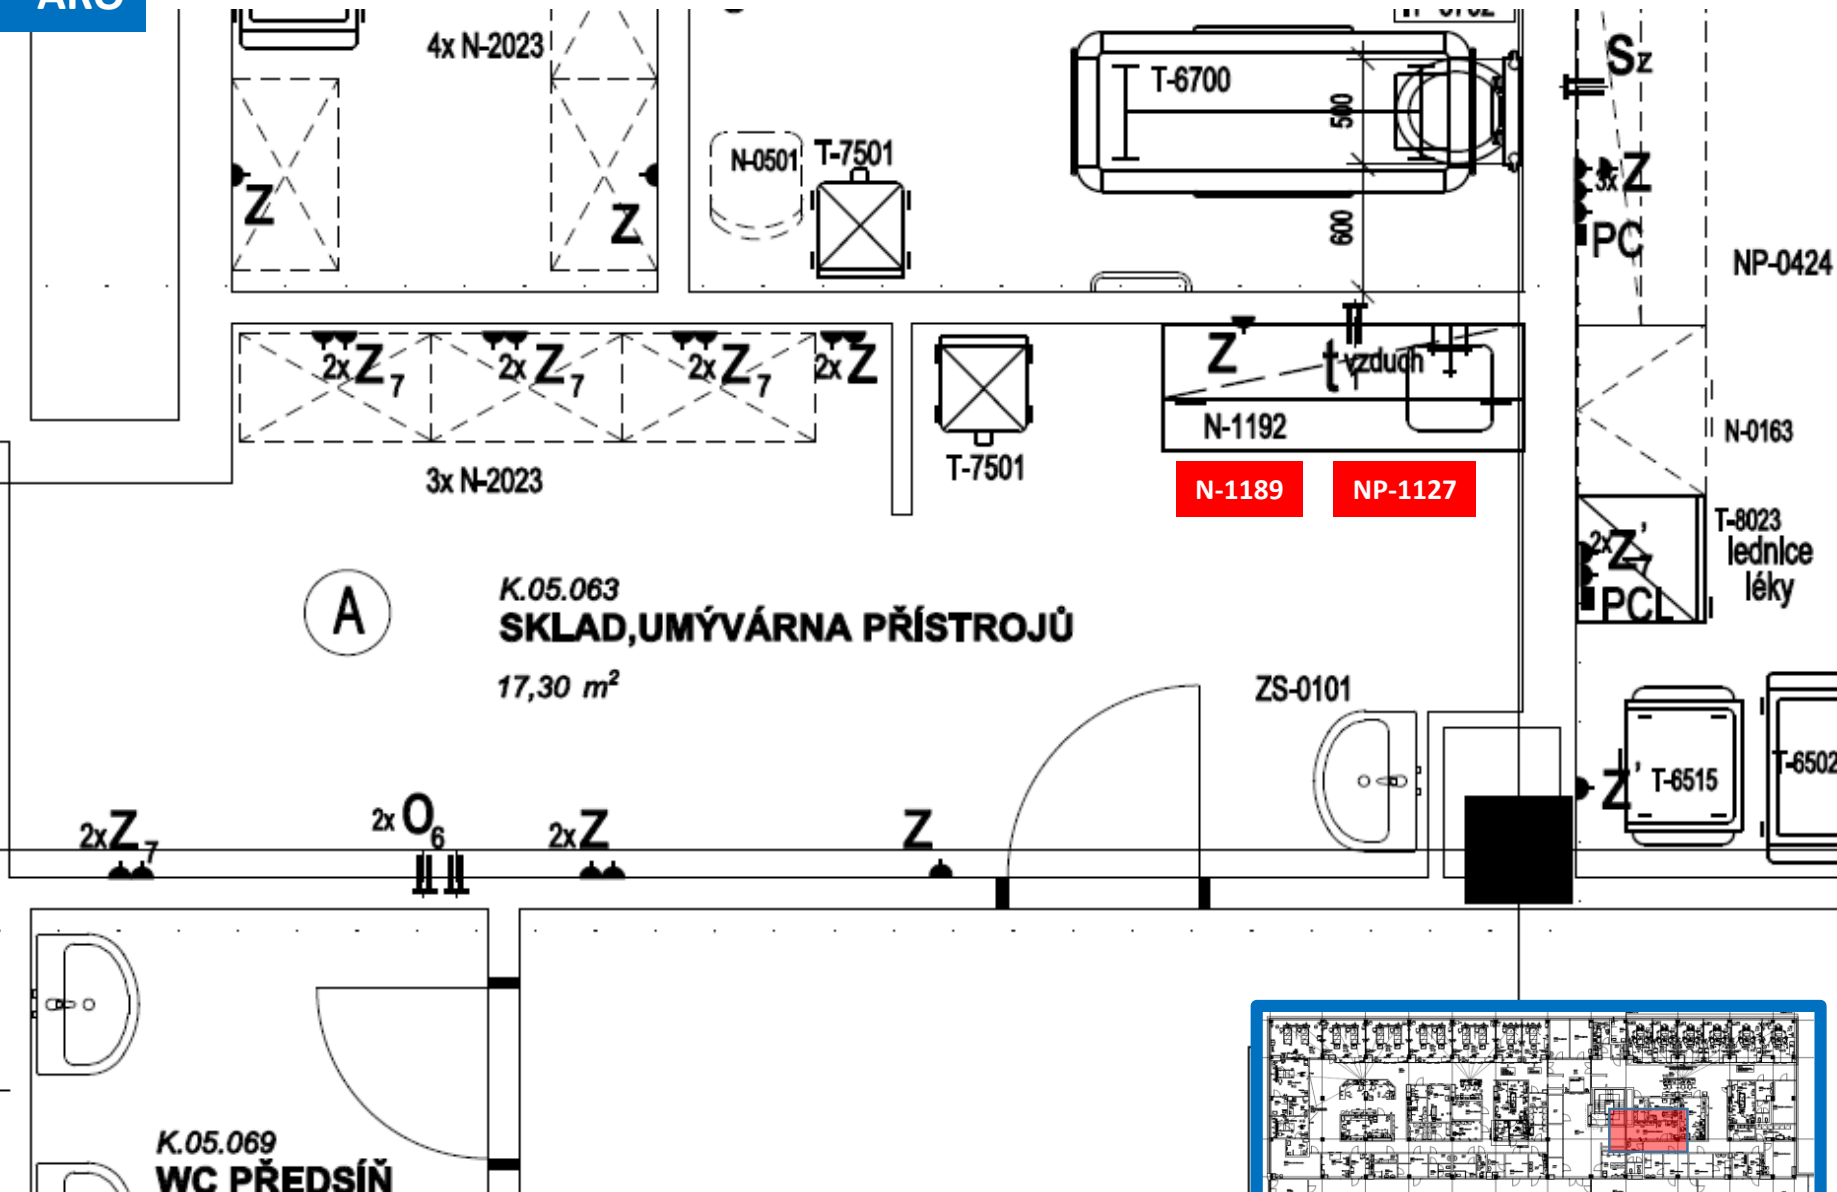

**K.05 NP – JIP**

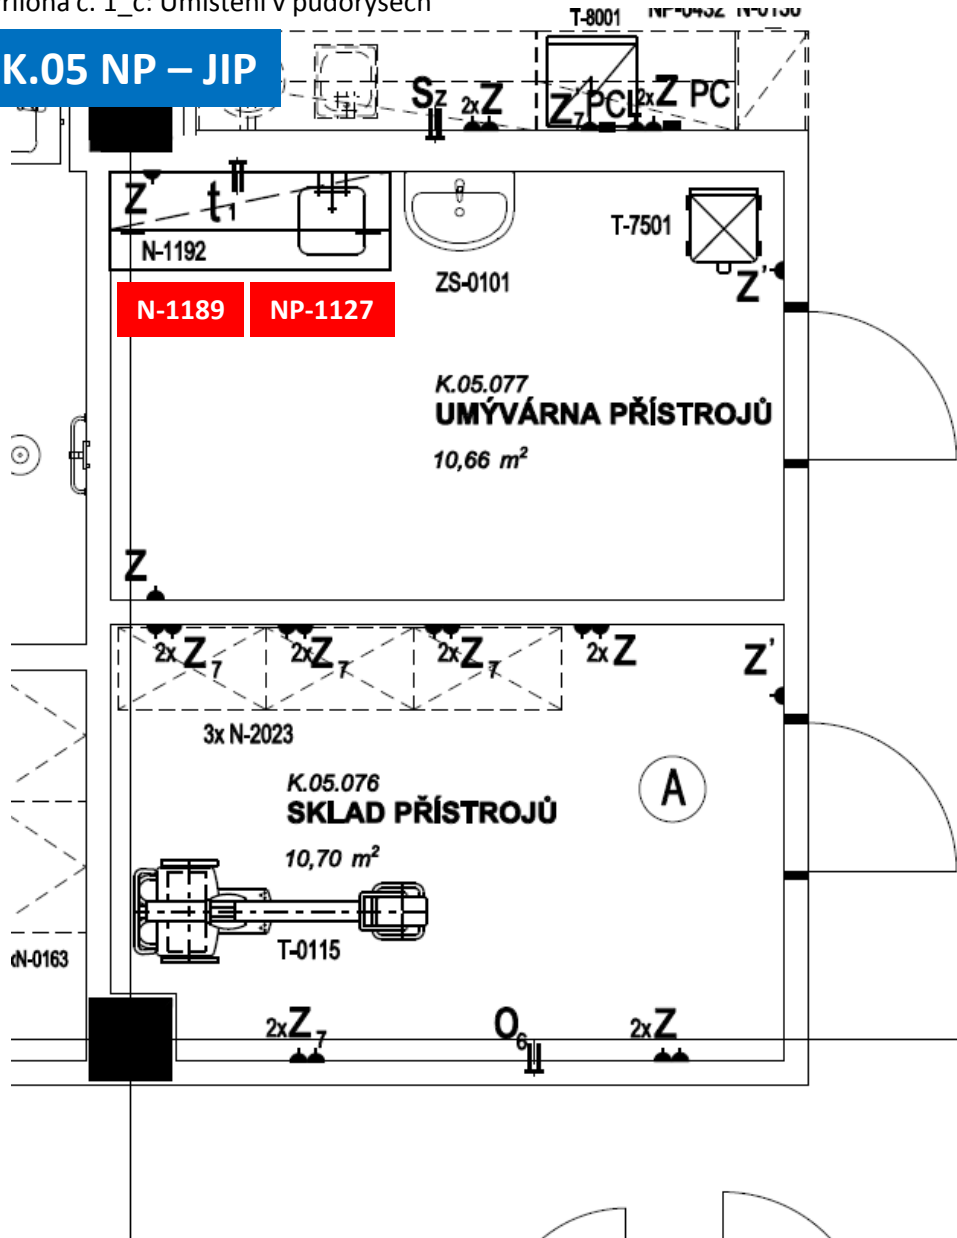


**ZMĚNA Č.16**

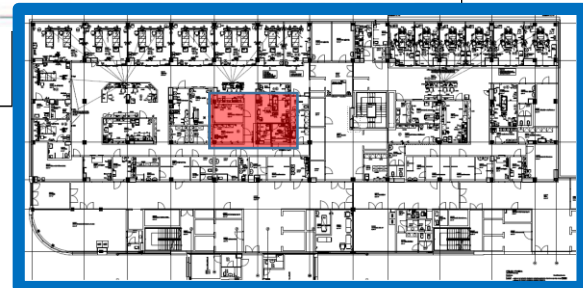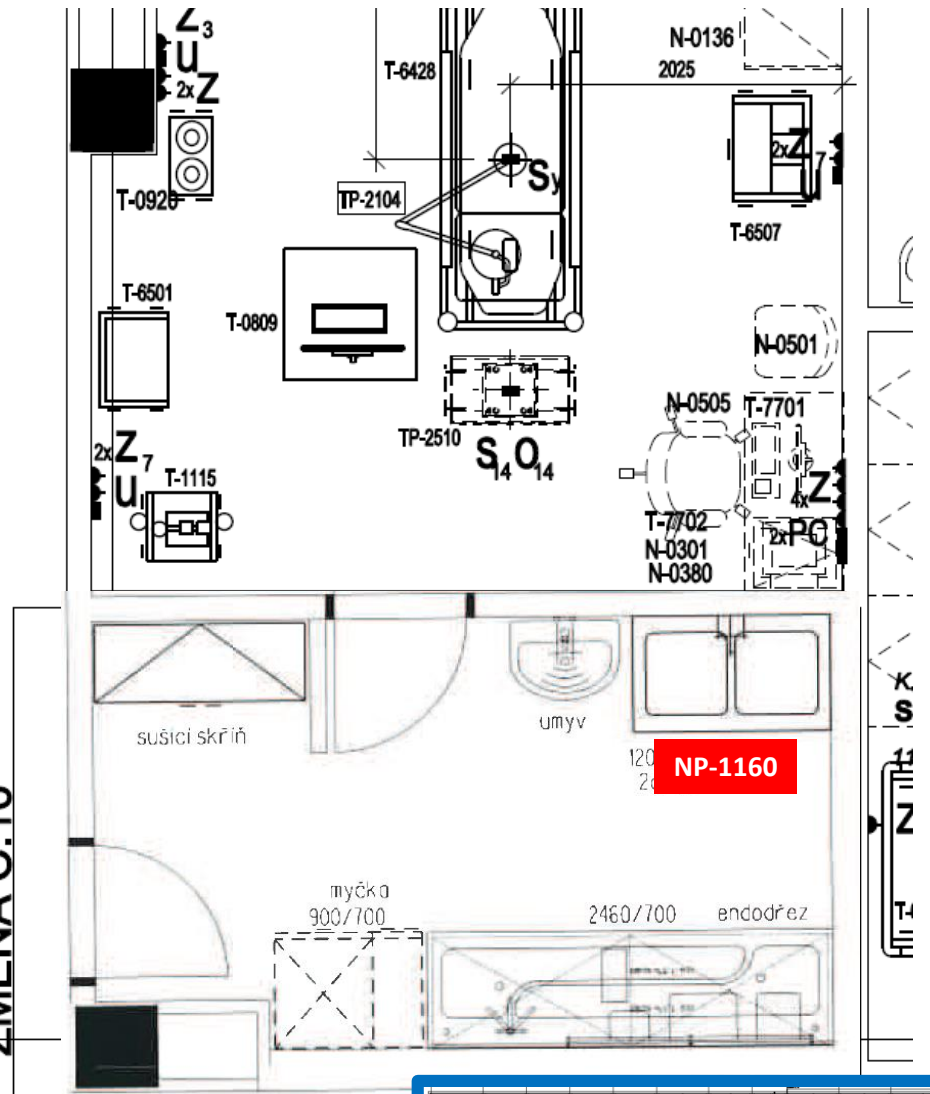



**K.05 NP – JIP**

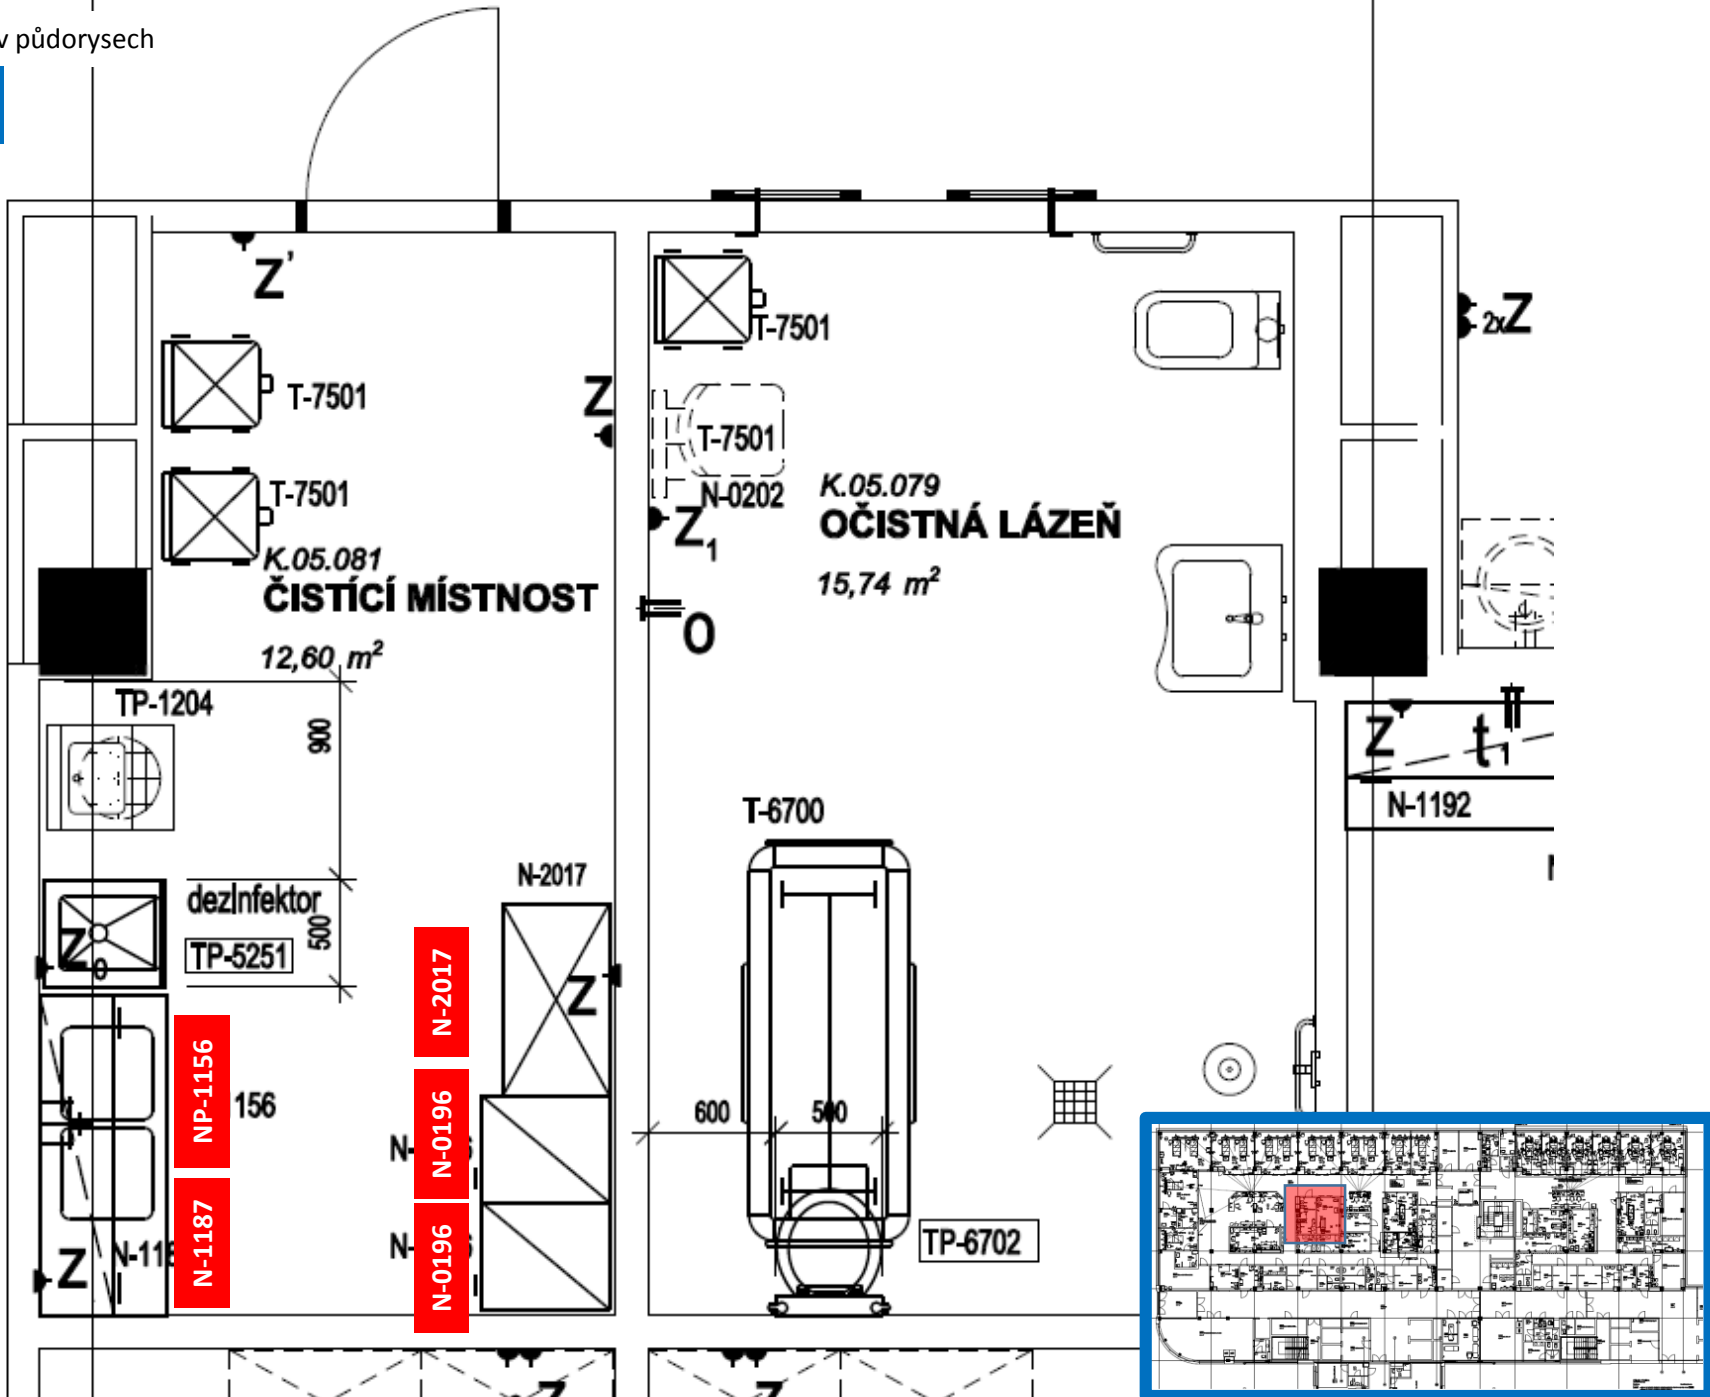







# K.07 NP – PORODNICE

